

2146 1/2 CLINTON AVE, ALAMEDA, CA 94501

(E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE

SCOPE OF WORK: REMODELED 1,532 SF +(P) ADDITION TO THE FIRST FLOOR 202.4 SF +(P) ADDITION TO THE BASEMENT FLOOR 202.4 SF TOTAL 1,936.8 SF

PROPERTY OWNER:

Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com

DESIGNER:

Andrew Atamaniuk
(213) 618-5456
permits@atamanstudio.com
Ataman Studio

SHEET INDEX (ARCHITECTURAL):

- A1 - TITLE PAGE
- A2 - TOPOGRAPHIC SURVEY
- A3 - TOPOGRAPHIC SURVEY
- A4 - TOPOGRAPHIC SURVEY
- A5 - EXISTING SITE PLAN
- A6 - EXISTING PLOT PLAN
- A7 - PROPOSED SITE PLAN
- A8 - PROPOSED PLOT PLAN
- A9 - EXISTING/DEMO FIRST FLOOR PLAN
- A9 - EXISTING/DEMO BASEMENT FLOOR PLAN
- A10 - PROPOSED FIRST FLOOR PLAN
- A10 - PROPOSED BASEMENT FLOOR PLAN
- A12 - WINDOW SCHEDULE
- A13.1 - ELEVATIONS
- A13.2 - ELEVATIONS
- A14 - CROSS SECTIONS
- A15 - ROOF PLAN
- A16 - PROPOSED FIRST FLOOR ELECTRICAL LAYOUT
- A16 - PROPOSED BASEMENT FLOOR ELECTRICAL LAYOUT
- A17 - ARCHITECTURAL DETAILS
- A18.1 - GREEN BUILDING NOTES
- A18.2 - GREEN BUILDING NOTES
- A18.3 - GREEN BUILDING NOTES

LOT CALCULATIONS:

Lot Area = 4,024 SF
(E) Two-Story SFD = 1,532 SF:
 (E) First-floor SFD = 756 SF
 (E) Basement-floor SFD = 776 SF
 (E) Porch = 75.1 SF
(P) Two-Story SFD = 1,936.8 SF:
 (P) First-floor SFD addition = 202.4 SF
(P) Total first-floor SFD = 958.4 SF
 (P) Basement-floor SFD addition = 202.4 SF
(P) Total basement-floor SFD = 978.4 SF


Total (E) + (P) = 1,532 + 75.1 + 202.4 + 202.4 = 2,011.9 SF
 Total SF(Living Area) = 1,532 + 202.4 + 202.4 = 1,936.8 SF

Lot Coverage = 2,011.9 / 4,024 = 50 %
 FAR = 1,936.8 / 4,024 = 48.13 %

VICINITY MAP/BUS STOP MAP (0.3 MILES)



ASSESSOR'S MAP

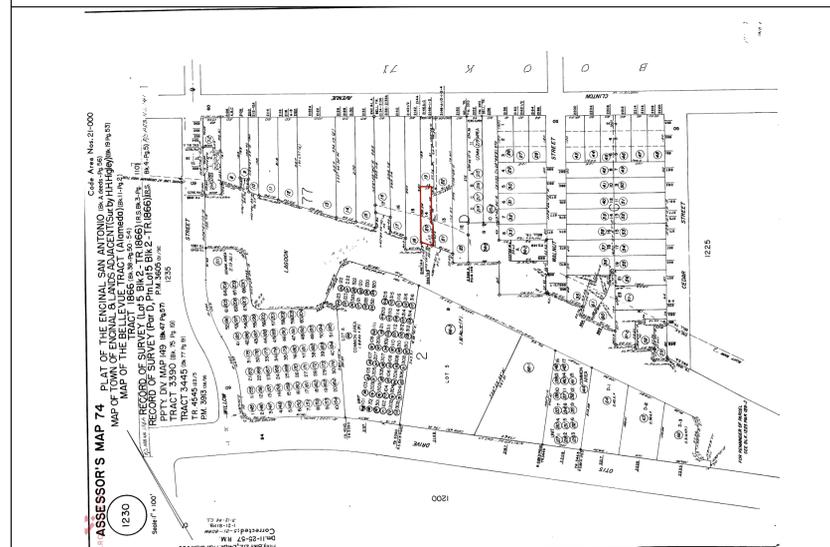

NOTES:

1. The proposed building is to be constructed by a contractor and architectural plans are based on site plans, exterior elevation, scaled floor plans and material construction specifications approved by the owner. The architectural plans are not intended to be comprehensive and it shall be the responsibility of the subcontractors to notify the contractor of any necessary clarifications or modifications.
2. All work connected with this projects shall be done in a professional manner in accordance with the traditionally and legally defined "best accepted practice" of the trade involved. Additionally all work shall comply with applicable codes and trade standards which govern each phase of work, including but not limited to the California Building Code (CBC), California Mechanical Code (CMC), California Fire Code (CFC), California Electrical Code (CEC), American Concrete Institute Code (ACI), California Plumbing Code (CPC) and all applicable local codes and/or legislation.
3. The design adequacy and safety of the erection, bracing, shoring and the temporary supports is the sole responsibility of the contractor. The contractor is responsible for the stability of the structure prior to the application of shear walls, roof and floor diaphragms, and finish materials.
4. The contractor shall be responsible for notifying the designer of any unusual or unforeseen foundation conditions, discrepancies of omissions within the plans or any deviations or changes from the plan before proceeding with the work involved; otherwise they will be considered adequate for proper completion of the project. The contractor shall be responsible to ensure that this inspection and supervision are provided by qualified persons.
5. In all cases written dimensions take precedence over scaled dimensions. Dimensions are to the face of stud or face of concrete unless otherwise noted. Larger scale details take precedence over smaller scale.
6. Layout all structural work by referring to dimensions and elevation notes on the architectural plans. Do not scale structural drawings, work detail dimensions from controlling surface.
7. Slope finish exterior surface away from foundation at min. of 2% slope.
8. Subcontractors always check and recheck the material and discuss the conflicts of notation/material between details, plans and sections with the general contractor or designer. Owner or designer shall not be hold responsible for the mistakes/errors made by sub or general contractors.
9. Project will follow construction waste management plan in conformance with calgreen 4.408.
10. Do not scale the drawing, use the dimensions only. If a discrepancy is found to exist, notify the owner.
11. These plans/specifications and all work shall comply with current edition of state of California Title 24 CCR and current UPC, UMC and NEC codes.
12. Details are intended to show method and manner of accomplishing work. Minor modifications may be required to suit the job dimensions or conditions and is to be reviewed and approved by the city.
13. Verify all dimensions and conditions at the site and stake out structure for owner's approval prior to starting any work.
14. All weather-exposed surfaces is to have a weather-resistive barrier to protect the interior wall covering and that exterior openings are to be flashed in such a manner as to make them weatherproof.

BUILDING CODES:

- 2022 California Administrative Code
- 2022 California Building Code
- 2022 California Residential Code
- 2022 California Electrical Code
- 2022 California Mechanical Code
- 2022 California Plumbing Code
- 2022 California Energy Code
- 2022 California Fire Code
- 2022 California Historical Building Code
- 2022 California Existing Building Code
- 2022 California Green Building Code
- 2022 California Referenced Standarts Code
- Alameda Municipal Code

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

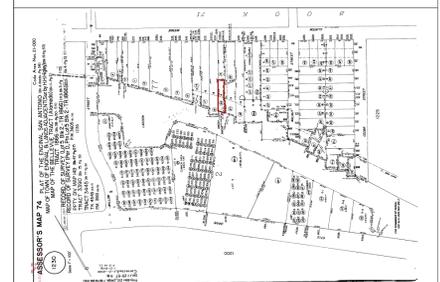

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: **DESIGN STAGE**

DESIGNER:  
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com

ATAMAN STUDIO

CLIENT: Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com


SITE: 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE: (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF TOTAL 1,936.8 SF

DRAWING TITLE: **TITLE PAGE**

SCALE AT ARCH D: DATE: 12/24/2025


PROJECT NO: DRAWING NO: **A1**

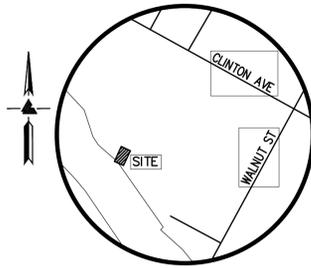

VICINITY MAP
NO SCALE

LEGEND AND NOTES

- BOUNDARY LINE
- - - BUILDING OVERHANG LINE
- ETC --- ELECTRICAL/TELEPHONE/
CABLE TV OVERHEAD LINE
- - - DECK OVERHEAD LINE
- - - EASEMENT
- x - FENCE LINE
- - - FLOW LINE
- SS - SANITARY SEWER LINE
- SD - STORM DRAIN LINE
- AD• AREA DRAIN
- BOL• BENCHMARK
- BW BOTTOM RETAINING WALL
- CB CATCH BASIN
- EM ELECTRICAL METER
- FF FINISH FLOOR
- FL FIRE HYDRANT
- FL FLOW LINE
- GM GAS METER
- GV GAS VALVE
- INV GUY ANCHOR
- INV INVERT
- ∅ JOINT POLE
- M- MULTI-TRUNK TREE
- RP ROOF PEAK
- SSCO SANITARY SEWER CLEAN-OUT
- SSMH SANITARY SEWER MAINTENANCE HOLE
- TC TOP OF CURB
- TS TRAFFIC SIGNAL
- TW TOP OF RETAINING WALL
- WM WATER METER
- XXX.XX SPOTGRADE
- ARTIFICIAL LAWN
- ASPHALT
- CONCRETE
- DECORATIVE BARK
- PAVERS
- RIVER ROCK
- WOOD

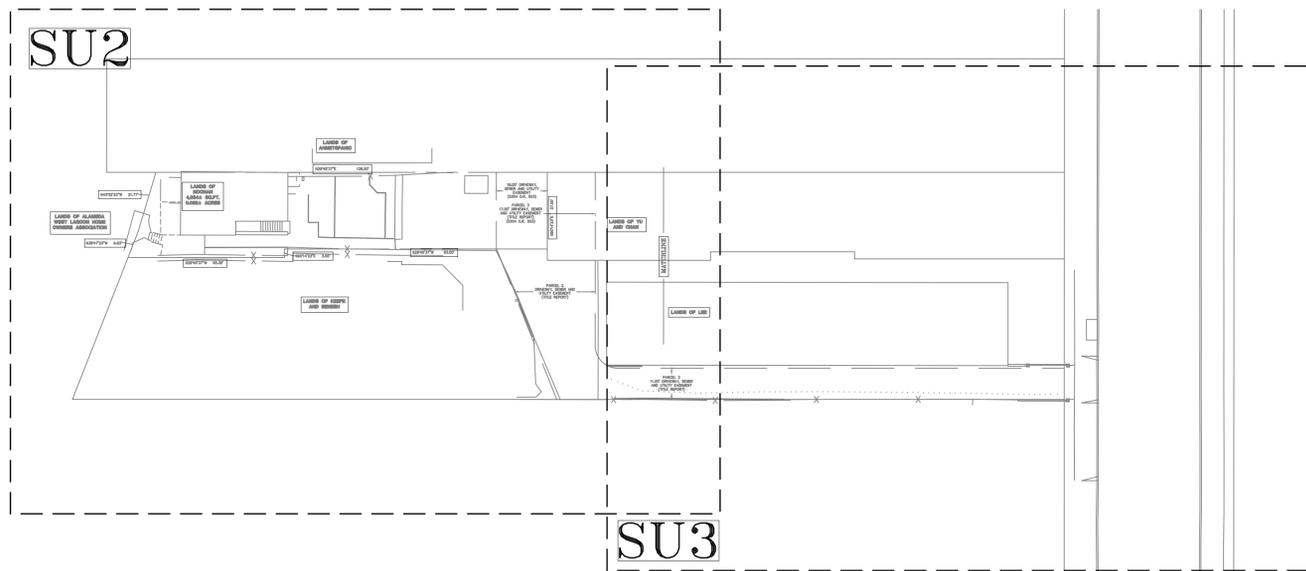

FEMA FLOOD NOTE

FLOOD ZONE: X (SHADED)
 AREA OF MODERATE FLOOD HAZARD, USUALLY THE AREA BETWEEN THE LIMITS OF THE 100-YEAR (1% ANNUAL CHANCE) AND 500-YEAR FLOODS (0.2% ANNUAL CHANCE) AND OUTSIDE OF THE SPECIAL FLOOD HAZARD AREA (SFHA)
 FEMA FLOOD INSURANCE RATE MAP NO.: 06001C0069H
 MAP REVISED: DECEMBER 21, 2018

EASEMENT NOTE

EASEMENTS ARE SHOWN PER PRELIMINARY TITLE REPORT ISSUED BY FIDELITY NATIONAL TITLE COMPANY, TITLE NO. FAMC-9281800092-KD, DATED AS OF JUNE 4, 2018
 AN EASEMENT FOR STORM DRAIN PURPOSES WAS RECORDED IN SERIES AP/28022. EASEMENT DESCRIPTION IS NOT LEGIBLE.

TREE NOTE

TREE SIZE, TYPE AND DRILLINES ARE BASED ON A VISUAL OBSERVATION. FINAL DETERMINATION SHOULD BE MADE BY THE PROJECT ARBORIST.

NOTES

ALL DISTANCES AND DIMENSIONS ARE IN FEET AND DECIMALS.
 BUILDING FOOTPRINTS ARE SHOWN TO FINISHED MATERIAL (STUCCO/SIDING).
 FINISH FLOOR ELEVATIONS ARE TAKEN AT DOOR THRESHOLD (EXTERIOR).
 THE AREA OF THE SURVEYED LOT IS 4,024± SQUARE FEET / 0.092± ACRES

UTILITY NOTE

ALL UNDERGROUND PIPE TYPES, SIZES AND LOCATION SHOWN ON THIS SURVEY ARE BASED ON VISUAL OBSERVATION. ANY USE OF THIS INFORMATION SHOULD BE VERIFIED, BEFORE ITS USE, WITH THE CONTROLLING MUNICIPALITY OR UTILITY PROVIDER. THIS SURVEY MAKES NO GUARANTEE OF THE INSTALLED ACTUAL LOCATION, DEPTHS OR SIZE.

BENCHMARK

CITY OF ALAMEDA BENCHMARK BM133 LOCATED AT WILLOW STREET AND SAN JOSE AVE. U.S.C. & G.S. MONUMENT, N.E. CORNER. ELEVATION = 17.361' (CITY OF ALAMEDA DATUM)

SITE BENCHMARK

SURVEY CONTROL POINT MAG AND SHINER SET IN ASPHALT ELEVATION = 16.45' (CITY OF ALAMEDA DATUM)



LEA & BRAZZE ENGINEERING, INC.
 CIVIL ENGINEERS / LAND SURVEYORS
 REGIONAL OFFICES:
 ROSEVILLE
 CLAYTON
 SAN LEANDRO
 SAN LUIS OBISPO
 WWW.LEABRAZZE.COM
 MAIN OFFICE:
 2495 INDUSTRIAL PARK WEST
 HAYWARD, CALIFORNIA 94545
 (510) 887-4066



2146 CLINTON AVENUE
 ALAMEDA
 CALIFORNIA

APN: 074-1230-020-00

ALAMEDA COUNTY

TOPOGRAPHIC SURVEY

REVISIONS	BY
JOB NO:	2250214
DATE:	4-11-25
SCALE:	1" = 30'
BNDY BY:	RM
FIELD BY:	MS
DRAWN BY:	JP
SHEET NO:	





A2



LEA & BRAZE ENGINEERING, INC.
 CIVIL ENGINEERS & LAND SURVEYORS
 REGIONAL OFFICES:
 ROSEVILLE
 LEAKSON
 SAN LUIS OBISPO
 WWW.LEABRAZE.COM

2146 CLINTON AVENUE
 ALAMEDA
 CALIFORNIA
 ALAMEDA COUNTY
 APN: 074-1230-020-00

TOPOGRAPHIC SURVEY

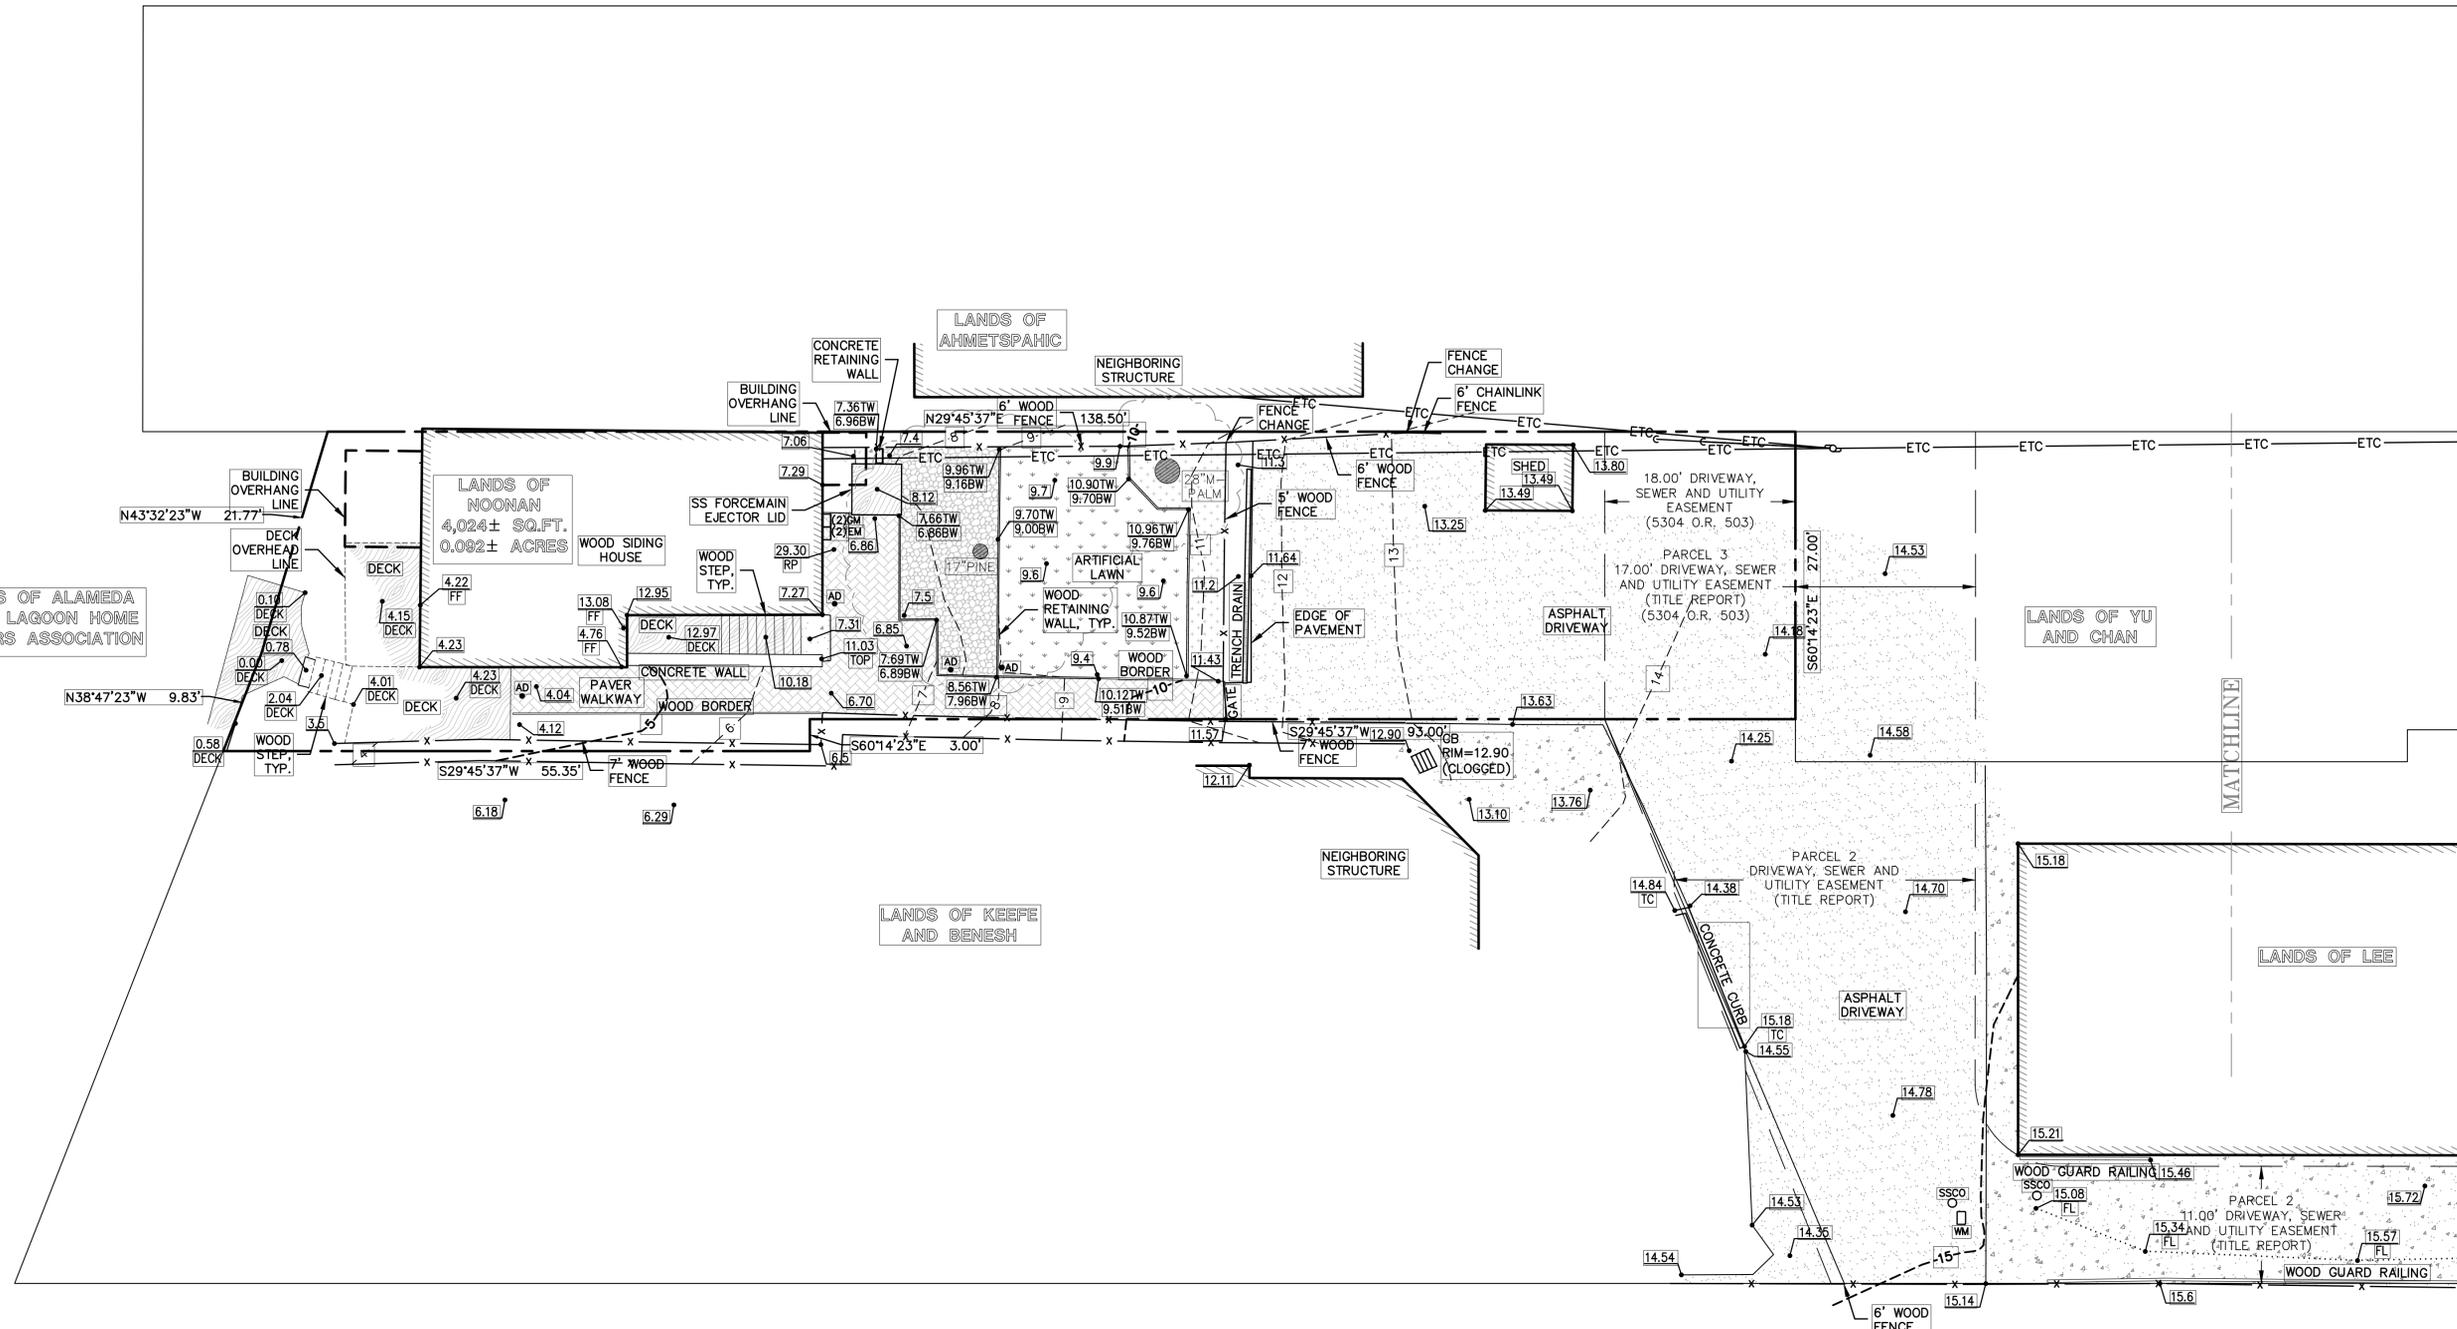

REVISIONS	BY

JOB NO: 2250214
 DATE: 4-11-25
 SCALE: 1"=8'
 BNDY BY: RM
 FIELD BY: MS
 DRAWN BY: JP
 SHEET NO:

A3

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

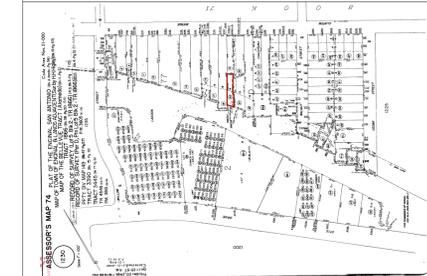

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: DESIGN STAGE

DESIGNER:
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com

SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501


TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE: **EXISTING SITE PLAN**

SCALE AT ARCH D: 1/16" = 1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO:

A5

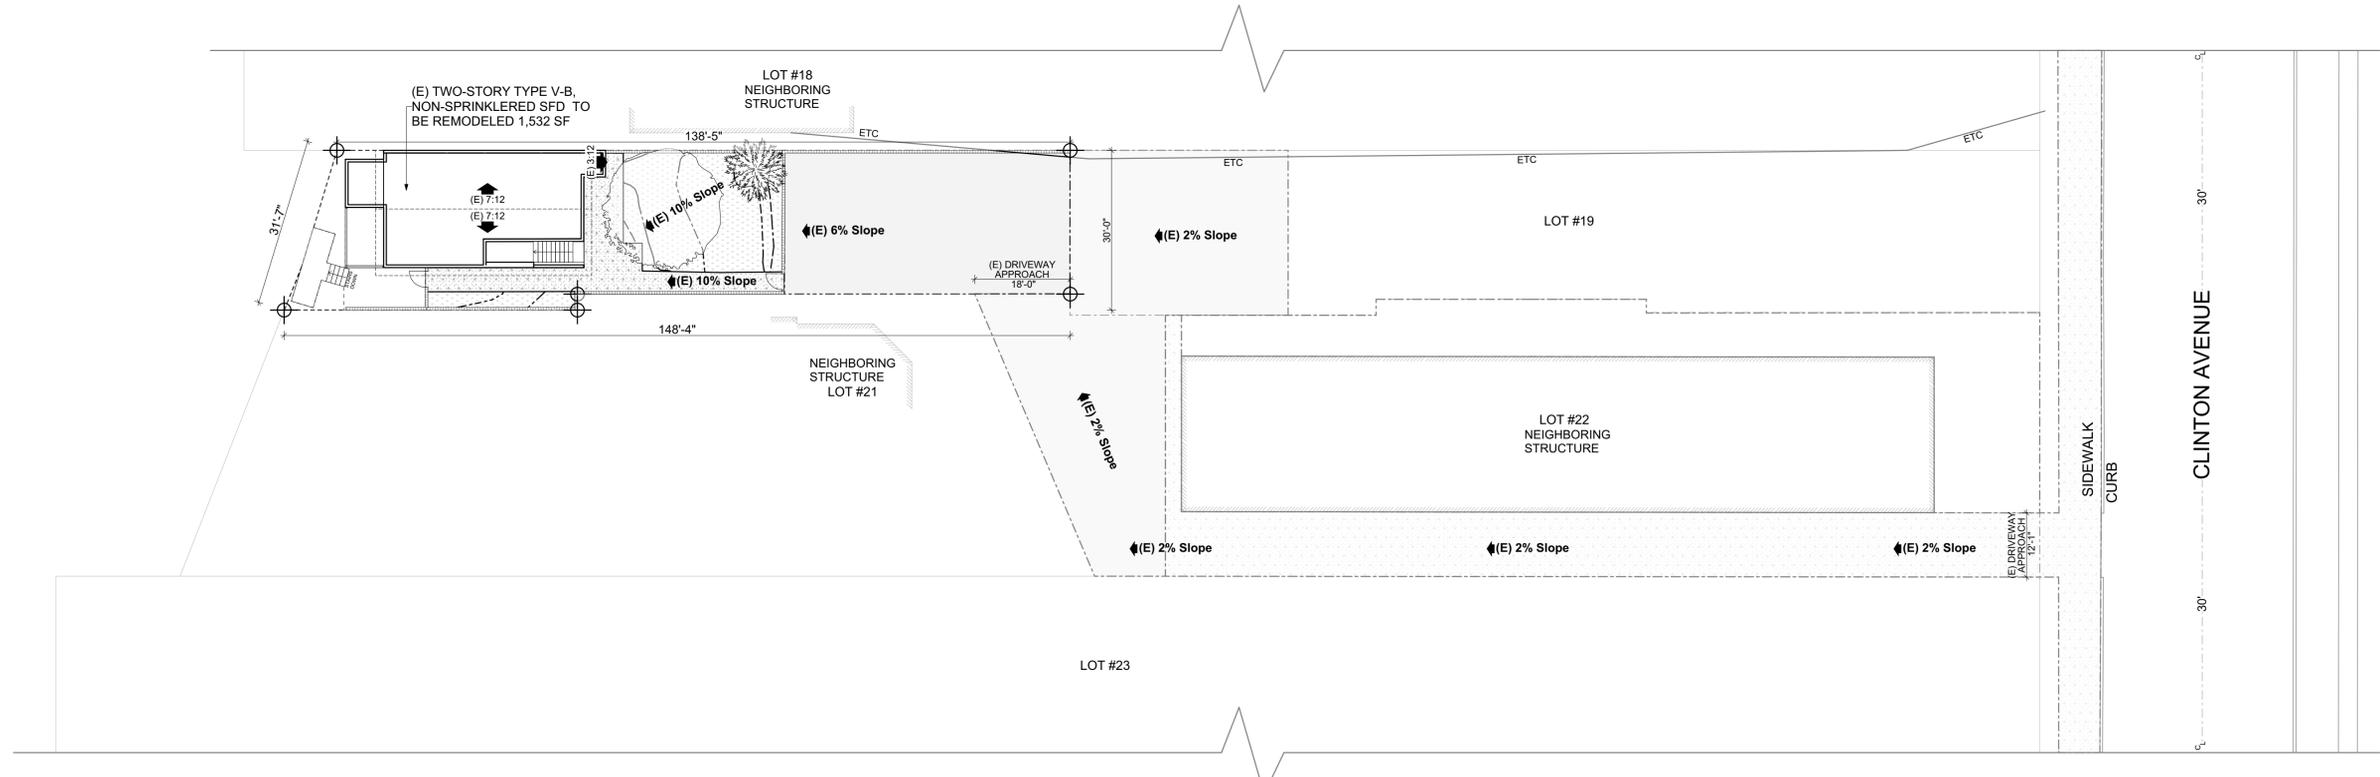

EXISTING SITE PLAN
 SCALE: 1/16" = 1'-0"

LOT INFORMATION:

ADDRESS:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

LEGAL DESCRIPTION:
 LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

Lot area: 4,024 SF (0.092 ac)
 Total (E) Living Area: 1,532 SF

LEGEND:

- | | | | |
|----|---------------|--|----------------|
| BL | Building line | | |
| | Grass area | | Drainage Slope |
| | Concrete area | | (E) Tree |
| | Asphalt area | | Existing Walls |
| | | | (E) Fences |

WALL TYPES:

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

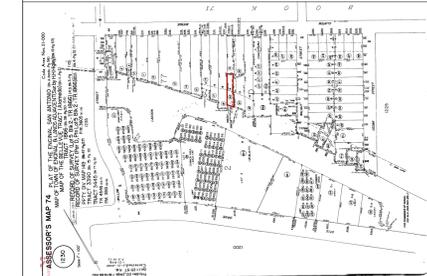

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: **DESIGN STAGE**

DESIGNER:
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com

SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF


EXISTING PLOT PLAN

SCALE AT ARCH D: 1/8" = 1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO:

A6

PHOTO 1

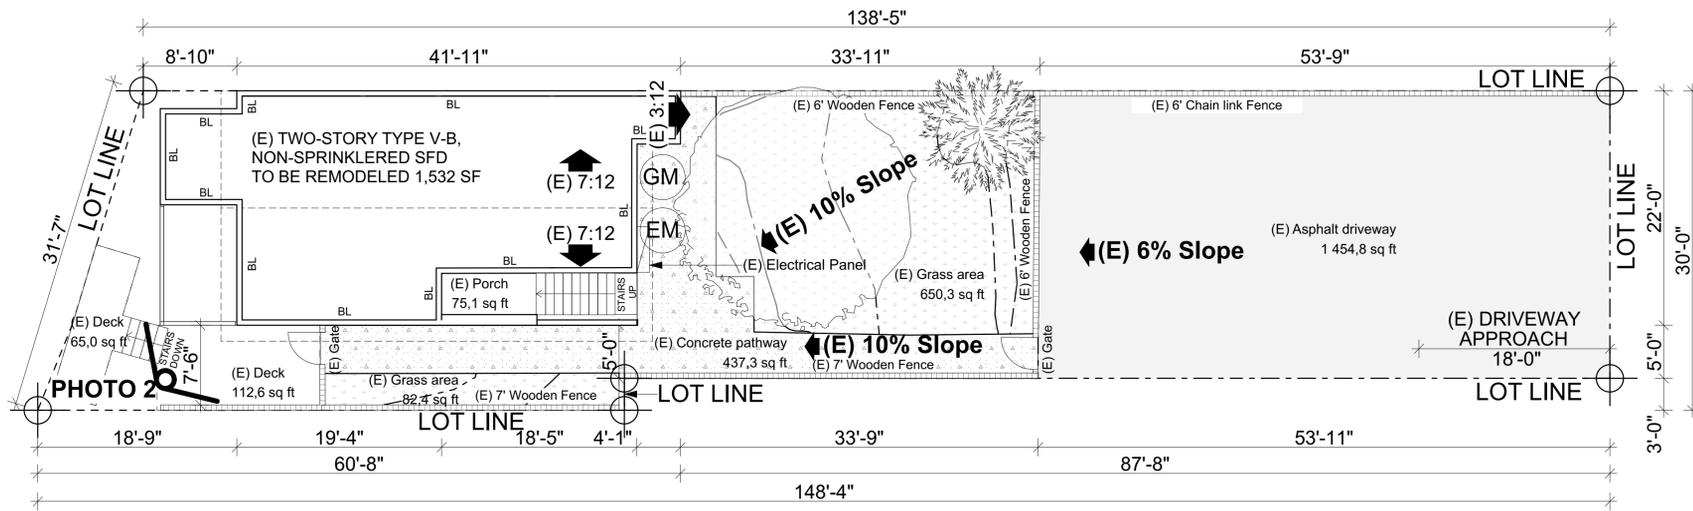

EXISTING PLOT PLAN

(E) Living area: 1,532 SF SCALE: 1/8" = 1'-0"



PHOTO 1



PHOTO 2

LEGEND:

- 2% Slope ▸ Drainage Slope
- BL Building line
- Grass area
- Concrete area
- Asphalt area
- (E) Tree
- EM Electrical Meter
- GM Gas Meter
- (E) Electrical Panel

- WALL TYPES:
- Existing Walls
 - (E) Fences

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

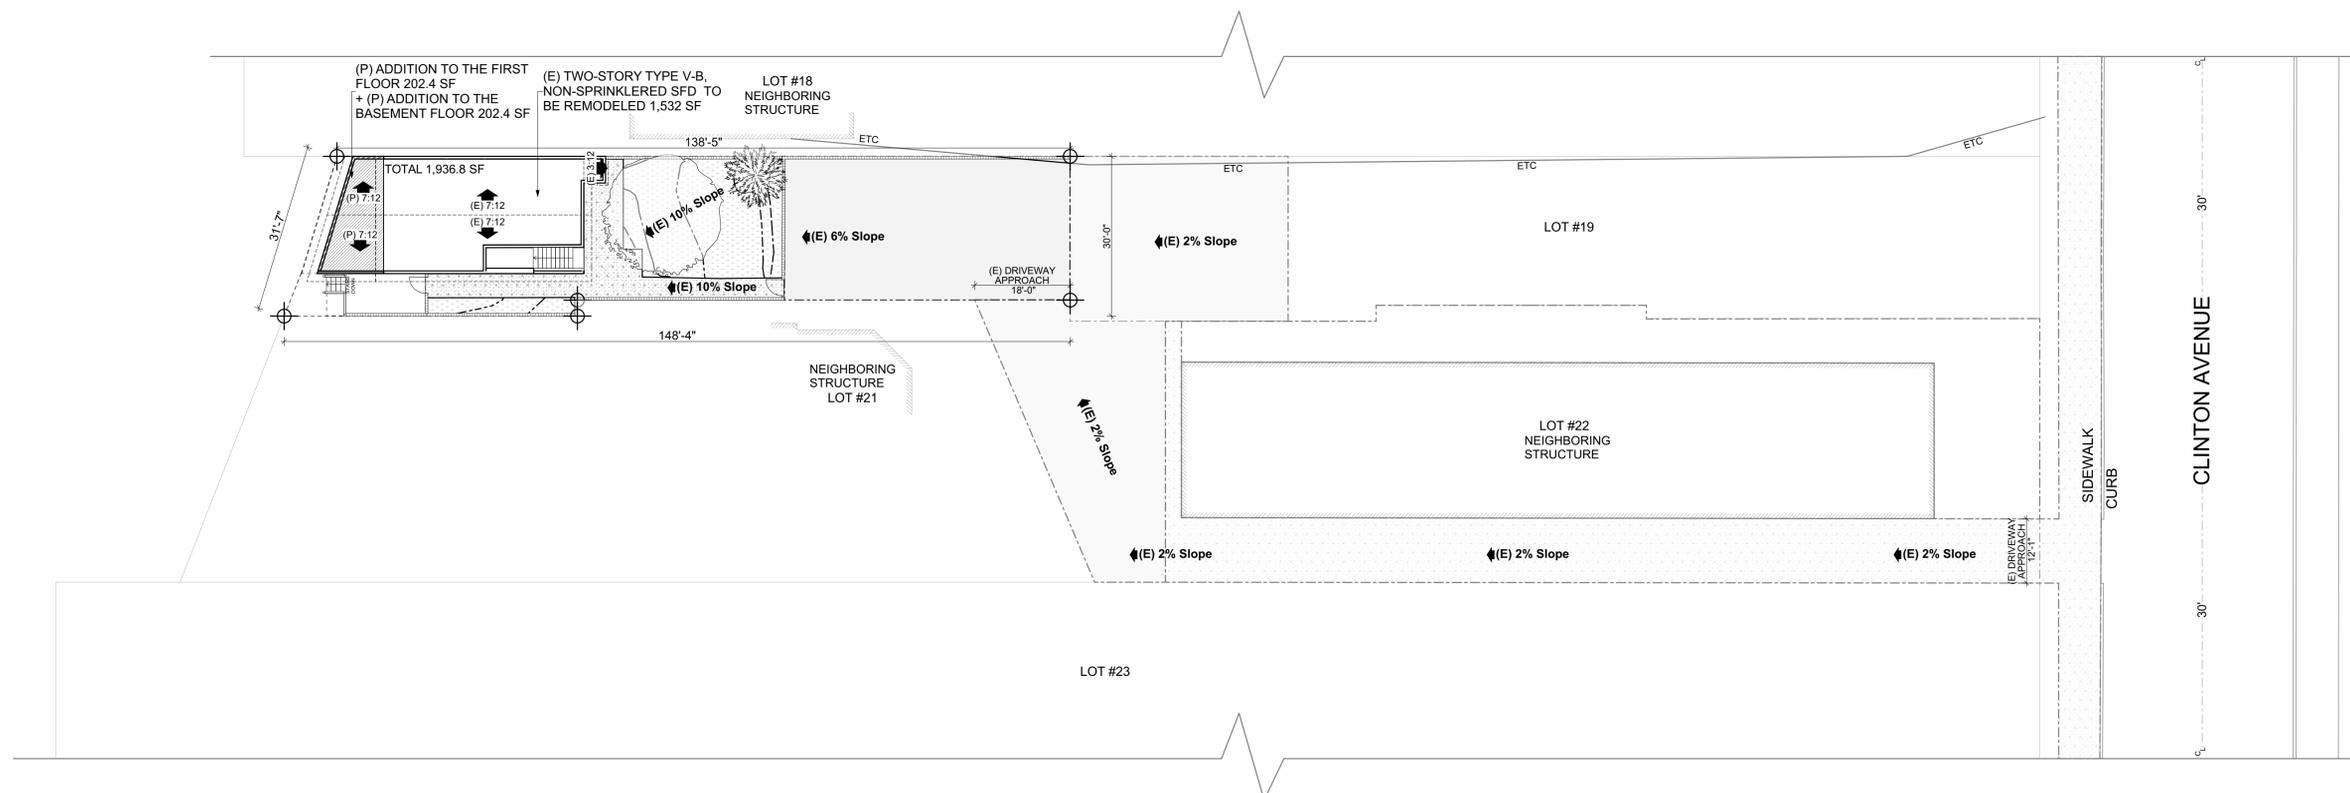

PROPOSED SITE PLAN
 SCALE: 1/16" = 1'-0"
 (P) Living area: 1,936.8 SF
 (E) Living area: 1,532 SF

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: **DESIGN STAGE**

DESIGNER:
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com

SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE: **PROPOSED SITE PLAN**

SCALE AT ARCH D: 1/16"=1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO:

A7

LOT INFORMATION:
 ADDRESS:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501
 LEGAL DESCRIPTION:
 LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B
 Lot area: 4,024 SF (0.092 ac)
 Total (E) Living Area: 1,532 SF
 Total (P) Living Area: 1,936.8 SF


PLOT PLAN CALC.:
 Lot Area = 4,024 SF
(E) Two-Story SFD = 1,532 SF:
 (E) First-floor SFD = 756 SF
 (E) Basement-floor SFD = 776 SF
 (E) Porch = 75.1 SF
(P) Two-Story SFD = 1,936.8 SF:
 (P) First-floor SFD addition = 202.4 SF
(P) Total first-floor SFD = 958.4 SF
 (P) Basement-floor SFD addition = 202.4 SF
(P) Total basement-floor SFD = 978.4 SF
 Total (E) + (P) = 1,532 + 75.1 + 202.4 + 202.4 = 2,011.9 SF
 Total SF(Living Area) = 1,532 + 202.4 + 202.4 = 1,936.8 SF
 Lot Coverage = 2,011.9 / 4,024 = 50 %
 FAR = 1,936.8 / 4,024 = 48.13 %

LEGEND:


BL	Building line	
	Grass area	(E) 2% Slope Drainage Slope
	Concrete area	(E) Tree
	Asphalt area	
	Proposed area	

WALL TYPES:

	Existing Walls
	Proposed Walls
	Proposed 1 HR. Fire/Sound Rated STC 50
	(E) Fences

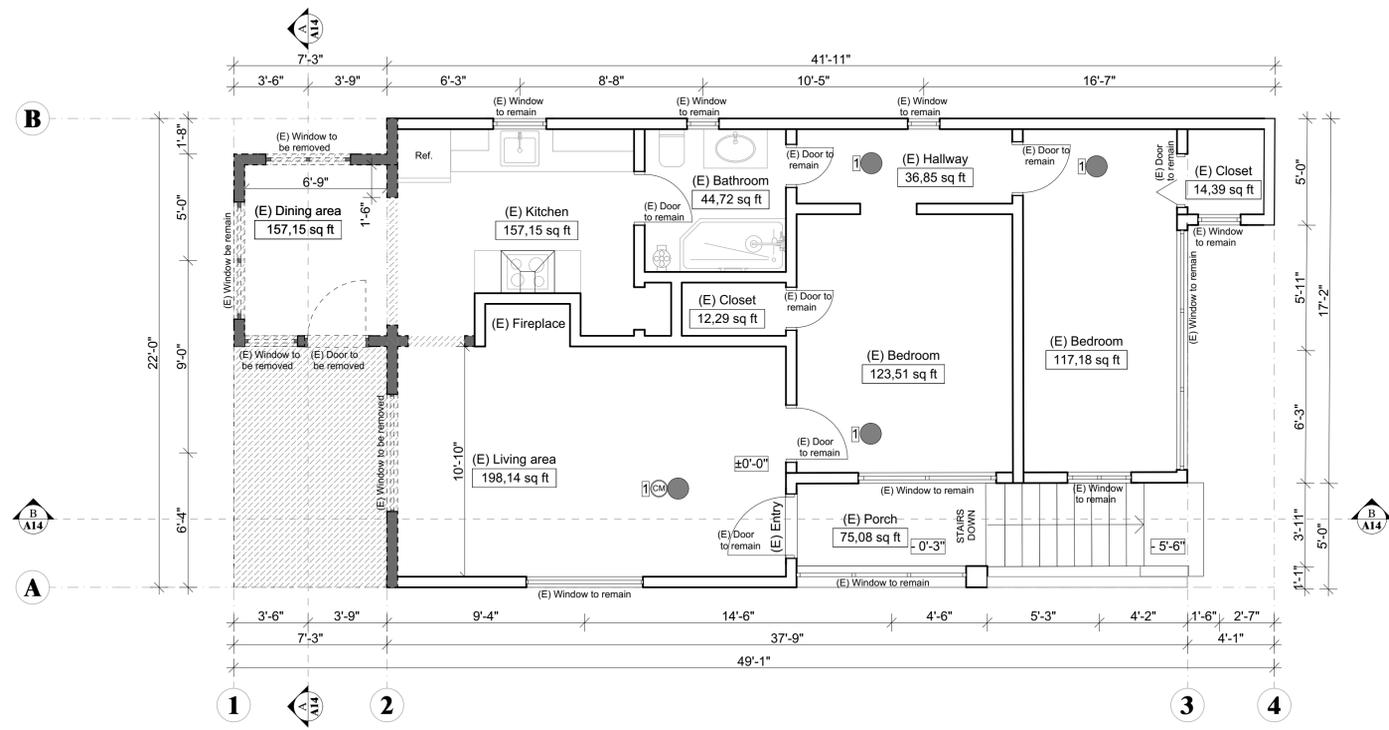

EXISTING/DEMO FIRST FLOOR PLAN
 (E) First floor area: 776 SF
 SCALE: 1/4" = 1'-0"

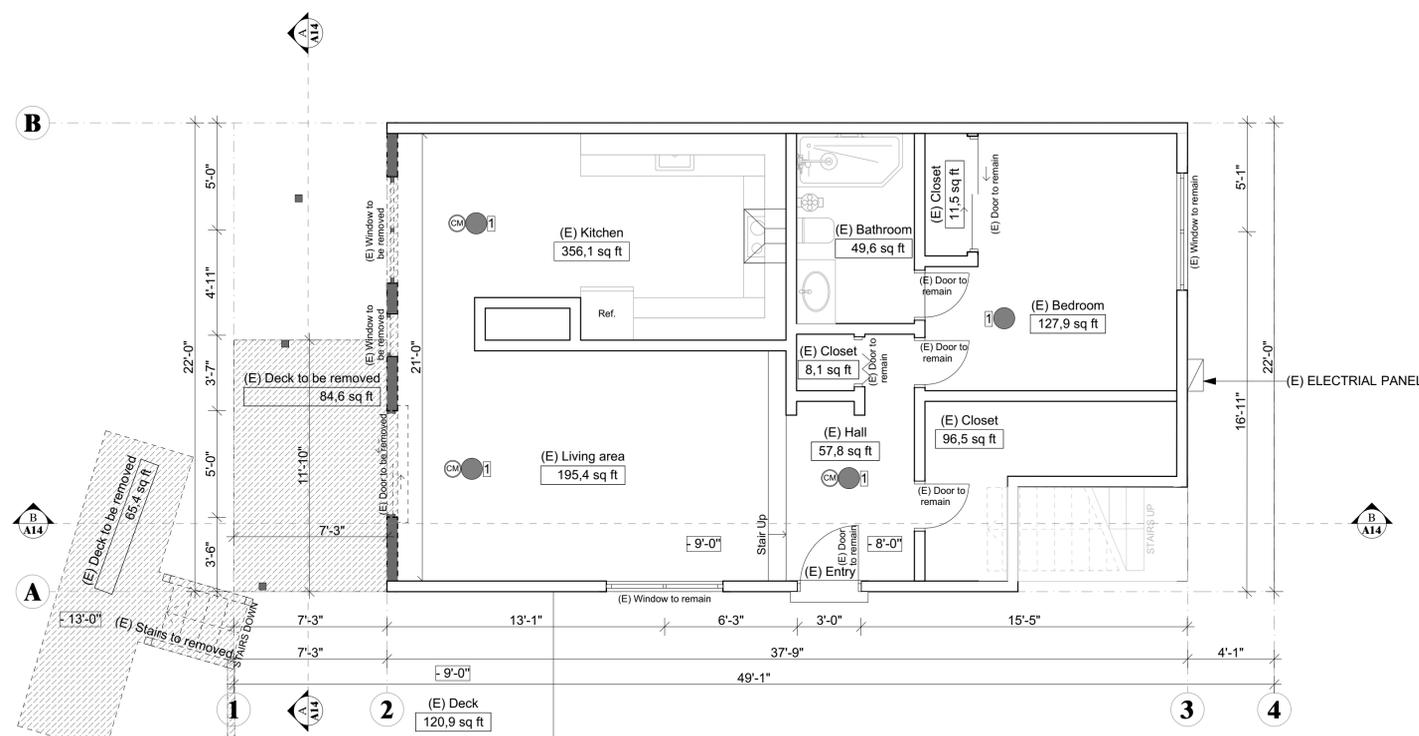

EXISTING/DEMO BASEMENT FLOOR PLAN
 (E) Basement floor area: 756 SF
 SCALE: 1/4" = 1'-0"

LEGEND:

- ⓘ KEYNOTE
- ⊗ DOOR SYMBOL
- ⊗ WINDOW SYMBOL
- ⊗ CARBON MONOXIDE ALARM
- SMOKE DETECTOR HARD WIRE
- ⊗ EXHAUST FAN
- ⊗ (E) ELECTRICAL PANEL
- ⊗ SECTION CALLOUT
- WALL TYPES:**
- EXISTING WALLS
- - - WALLS TO BE DEMOLISHED

KEYNOTES:

- ⓘ R314.3 Location
 Smoke alarms shall be installed in the following locations:
 1. In each sleeping room.
 2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
 3. On each additional story of the dwelling, including basements and habitable attics and not including crawl spaces and uninhabitable attics. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.
 4. Not less than 3 feet (914 mm) horizontally from the door or opening of a bathroom that contains a bathtub or shower unless this would prevent placement of a smoke alarm required by this section.
 5. In the hallway and in the room open to the hallway in dwelling units where the ceiling height of a room open to a hallway serving bedrooms exceeds that of the hallway by 24 inches (610 mm) or more.
- ⓘ R315.3 Location
 Carbon monoxide alarms in dwelling units shall be installed and maintained in accordance with the manufacturer's published instructions in the following locations:
 1. Outside of each separate sleeping area in the immediate vicinity of the bedrooms.
 2. On every occupiable level of a dwelling unit, including basements.
 3. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom.
 Smoke detector UL217 . Carbon monoxide detectorUL2034/2075

GENERAL NOTES:

- All dimensions to face of stud, U.O.N.
- All doors should be 3 1/2" from nearest intersecting wall at hinged side, U.O.N.
- Written dimensions to prevail over scaling of drawings. contractor to verify all dim. prior to construction and immediately notify owner of any discrepancies.
- Transition of floor materials occurring in openings with doors to be located under the center of the door in closed position. transition of floor material occurring with no door to be located to align with the face of the partition, U.O.N.
- Floor finish to continue under millwork where floor is visible (i.e. trash, recycling, ect.).
- All finish material must meet all application fire, life safety, and building codes.
- Operation and maintenance manual; the builder is to provide an operation manual (containing information for the maintaining appliances, etc.) for the owner at the time of final inspection.

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

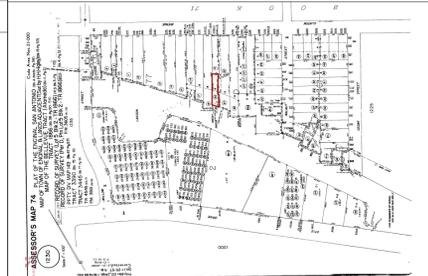

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: **DESIGN STAGE**

DESIGNER:
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com



SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED
 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF
 + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE:
EXISTING/DEMO FIRST FLOOR PLAN
EXISTING/DEMO BASEMENT FLOOR PLAN

SCALE AT ARCH D: 1/8"-1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO:

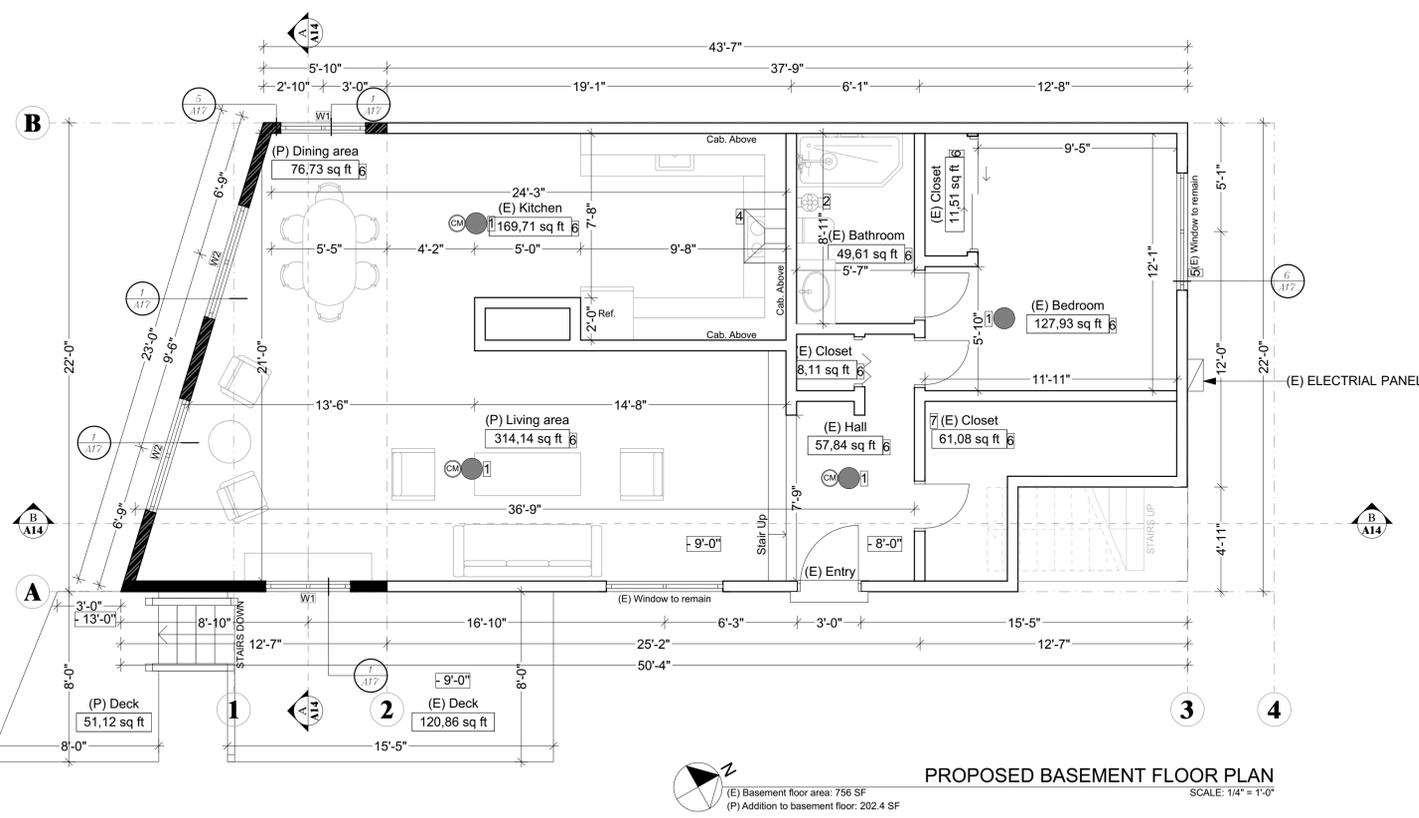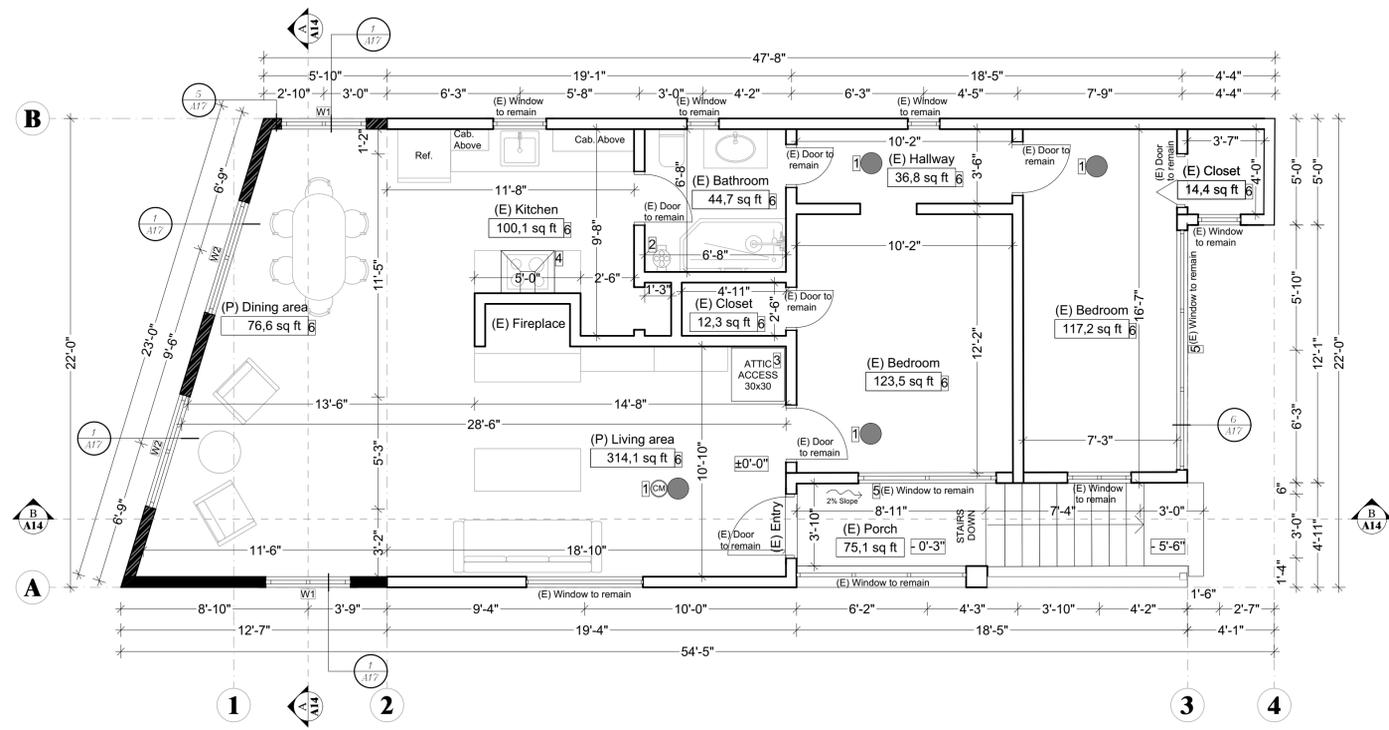

LEGEND:

- KEYNOTE
- DOOR SYMBOL
- WINDOW SYMBOL
- CARBON MONOXIDE ALARM
- SMOKE DETECTOR HARD WIRE
- EXHAUST FAN
- (E) ELECTRICAL PANEL
- DETAIL CALLOUT
- SECTION CALLOUT
- WALL TYPES:**
- EXISTING WALLS
- PROPOSED WALLS
- PROPOSED 1 HR. FIRE/SOUND RATED STC 50

KEYNOTES:

- R314.3 Location
Smoke alarms shall be installed in the following locations:
 1. In each sleeping room.
 2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
 3. On each additional story of the dwelling, including basements and habitable attics and not including crawl spaces and uninhabitable attics. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.
 4. Not less than 3 feet (914 mm) horizontally from the door or opening of a bathroom that contains a bathtub or shower unless this would prevent placement of a smoke alarm required by this section.
 5. In the hallway and in the room open to the hallway in dwelling units where the ceiling height of a room open to a hallway serving bedrooms exceeds that of the hallway by 24 inches (610 mm) or more.
 R315.3 Location
Carbon monoxide alarms in dwelling units shall be installed and maintained in accordance with the manufacturer's published instructions in the following locations:
 1. Outside of each separate sleeping area in the immediate vicinity of the bedrooms.
 2. On every occupiable level of a dwelling unit, including basements.
 3. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom.
 Smoke detector UL217 . Carbon monoxide detector UL2034/2075
- Provide Mechanical ventilation providing 7 1/2 air changes per hour (50 CFM Min. Rate) Energy Star with humidity control @ detach to terminate building
- 22" x 30" attic access, or 30" x 30" if furnace is in attic. min headroom of 30". (r807.1, mc 304.1)
- Kitchen hood with 100 CFM over the stove.
- R310.2.1 Minimum Size
Emergency escape and rescue openings shall have a net clear opening of not less than 5.7 square feet (0.530 m2).
Exception: The minimum net clear opening for grade floor emergency escape and rescue openings shall be 5 square feet (0.465 m2).
R310.2.2 Minimum Dimensions
The minimum net clear opening height dimension shall be 24 inches (610 mm). The minimum net clear opening width dimension shall be 20 inches (508 mm). The net clear opening dimensions shall be the result of normal operation of the opening.
R310.2.3 Maximum Height From Floor
Emergency escape and rescue openings shall have the bottom of the clear opening not greater than 44 inches (1118 mm) measured from the floor.
- Net Floor Area (without walls)
- R302.7 Under-Stair Protection
Enclosed space under stairs that is accessed by a door or access panel shall have walls, under-stair surface and any soffits protected on the enclosed side with 1/2-inch (12.7 mm) gypsum board.

GENERAL NOTES:

- All dimensions to face of stud, U.O.N.
- All doors should be 3 1/2" from nearest intersecting wall at hinged side, U.O.N.
- Written dimensions to prevail over scaling of drawings. contractor to verify all dim. prior to construction and immediately notify owner of any discrepancies.
- Transition of floor materials occurring in openings with doors to be located under the center of the door in closed position. transition of floor material occurring with no door to be located to align with the face of the partition, U.O.N.
- Floor finish to continue under millwork where floor is visible (i.e. trash, recycling, ect.). All finish material must meet all application fire, life safety, and building codes.
- Operation and maintenance manual; the builder is to provide an operation manual (containing information for the maintaining appliances, etc.) for the owner at the time of final inspection.

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

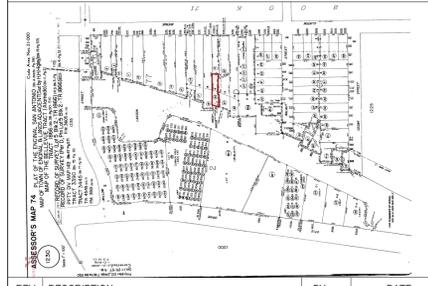

REV:	DESCRIPTION:	BY:	DATE:

STATUS: DESIGN STAGE

DESIGNER:
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com

SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED
 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF
 + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE:
**PROPOSED FIRST FLOOR PLAN
 PROPOSED BASEMENT FLOOR PLAN**

SCALE AT ARCH D: 1/4" = 1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO: **A10**

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.

THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP



REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: DESIGN STAGE

DESIGNER:

(213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com




ATAMAN STUDIO

CLIENT:
 Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com



SITE:
 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE:
 (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED
 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF
 + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE: WINDOW SCHEDULE


SCALE AT ARCH D: 1/4"=1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO: A12


WINDOW SCHEDULE							
SYM.	W x H SIZE	Sq. Ft	TYPE	U-Factor	SHGC	DRAWING	QUANTITY
W1	4'-0"x4'-0"	16.00	SLIDING				4
W2	5'-6"x4'-0"	22.00	SLIDING				4

WINDOWS NOTES:

- SEE EXTERIOR ELEVATION FOR DIRECTION OF OPERATION OF WINDOWS (ALL OPERABLE WINDOWS TO HAVE SCREENS).
- ALL WINDOW DIMENSIONS PERTAIN TO ROUGH OPENINGS (R.O.), CONTRACTOR TO FIELD VERIFY ACTUAL DIMENSIONS FOR WINDOWS
- ALL GLAZING WILL BE INSTALLED WITH A CERTIFYING LABEL ATTACHED, SHOWING THE NFRC LABEL.
- ALL GLAZING SHALL BE SPECTRALLY SELECTIVE LOW E COATED TO MEET TITLE 24 ENERGY REQUIREMENTS.
- WINDOWS SHALL MEET THE MINIMUM INFILTRATION REQUIREMENTS PER SECTION 116 E.E.S.D
- VENTILATION SHALL COMPLY WITH C.B.C. 1203.4 AND R303
- EVERY SLEEPING ROOM SHALL HAVE ONE OPERABLE WINDOW FOR EMERGENCY ESCAPE OR RESCUE WITH A MIN. NET CLEAR OPENABLE AREA OF 5.7 SQ. FT. MIN. NET CLEAR OPENABLE HEIGHT OF 24" MIN., NET CLEAR WIDTH OF 20" AND A FIN. SILL HEIGHT OF NOT MORE THAN 44" A.F.F. PER CRC SECTION 3101
- ALL EXTERIOR WINDOW AND EXTERIOR DOOR ASSEMBLIES TO HAVE AN STC RATING OF 36 OR GREATER.
- TEMPERED GLASS SHALL BE PERMANENTLY IDENTIFIED AND VISIBLE WHEN THE UNIT IS GLAZED.
- EVERY SPACE INTENDED FOR HUMAN OCCUPANCY SHALL BE PROVIDED WITH NATURAL VENTILATION AND NATURAL LIGHT BY MEANS OF VENTILATION / ARTIFICIAL LIGHT. CBC SECTIONS 1203.4 AND 1205.1 AND R303
- A) THE MINIMUM NET GLAZED AREA FOR NATURAL LIGHT SHALL NOT BE LESS THAN 8% OF THE FLOOR AREA OF THE ROOM SERVED. CBC SECTION 1205.2
- B) THE MINIMUM OPENABLE AREA TO THE OUTDOORS FOR NATURAL VENTILATION SHALL BE 4% OF THE FLOOR AREA BEING VENTILATED. SECTION 1203.4
- EXTERIOR WALLS, WINDOW WALLS, GLAZED OPENING WITH EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM TEMPERED PANE
- FIRE-EXISTING RATED GLAZING TESTED AS A PART OF FIRE-RESISTANCE-RATED WALL ASSEMBLY IN ACCORDANCE WITH ASTM E 119 OR UL 263 TO BE CONSTRUCTED OF MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENT OF SECTION 2406. CONSTRUCTED OF GLASS BLOCK UNITS, OR HAVE A FIRE-RESISTIVE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 257
- GLAZING IN SHOWERS OR BATHTUB ADJACENT WALL OPENINGS WITHIN 60 INCHES ABOVE A STANDING SURFACE AND DRAIN INLET SHALL BE FULLY TEMPERED, LAMINATED SAFETY GLASS, OR APPROVED PLASTIC (CRC R308.4)
- USE DOUBLE GLASS-LOW-E.
- WINDOWS SUPPOSED TO BE DOUBLE PAN. WINDOW FRAME - DLB. CLR.

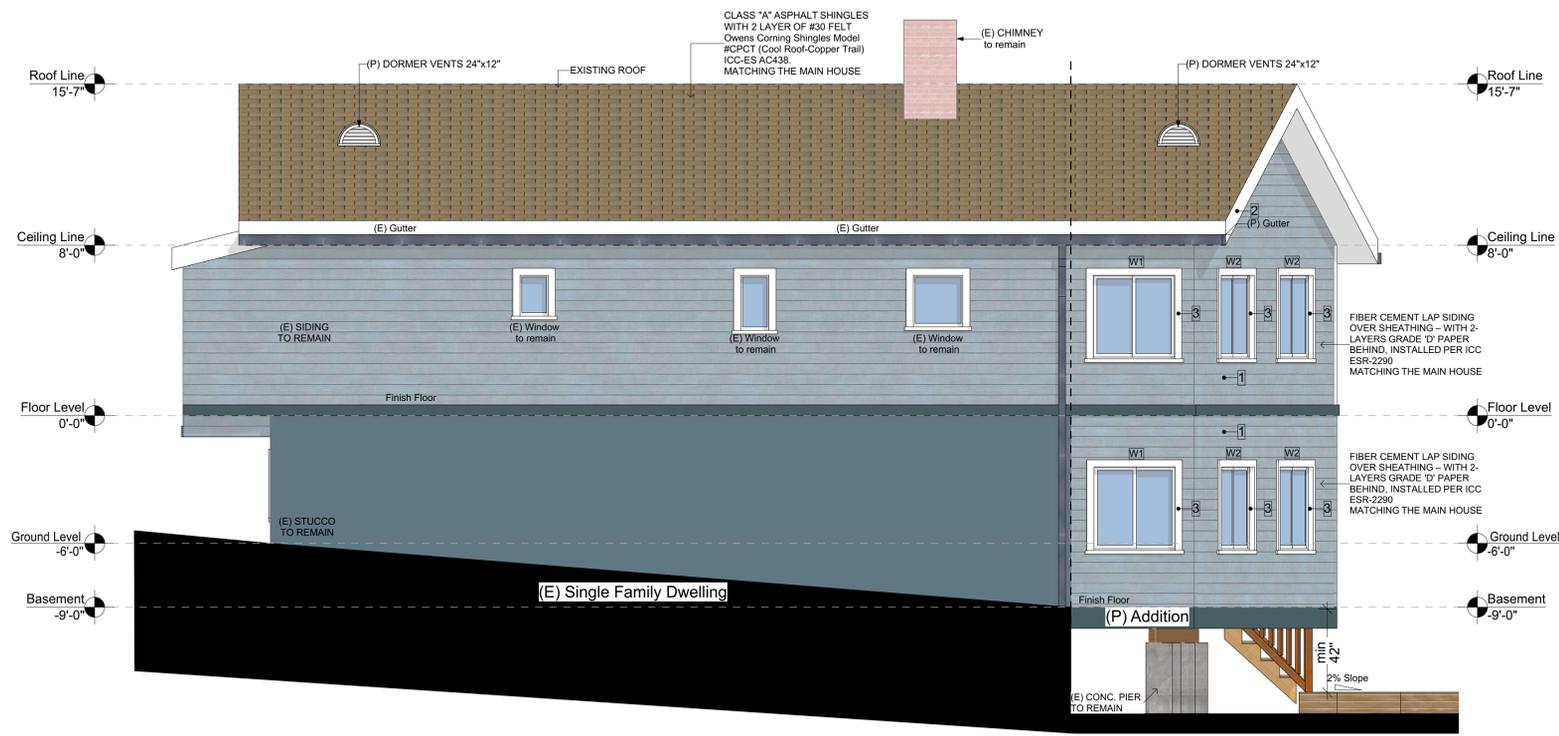

PROPOSED NORTH EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

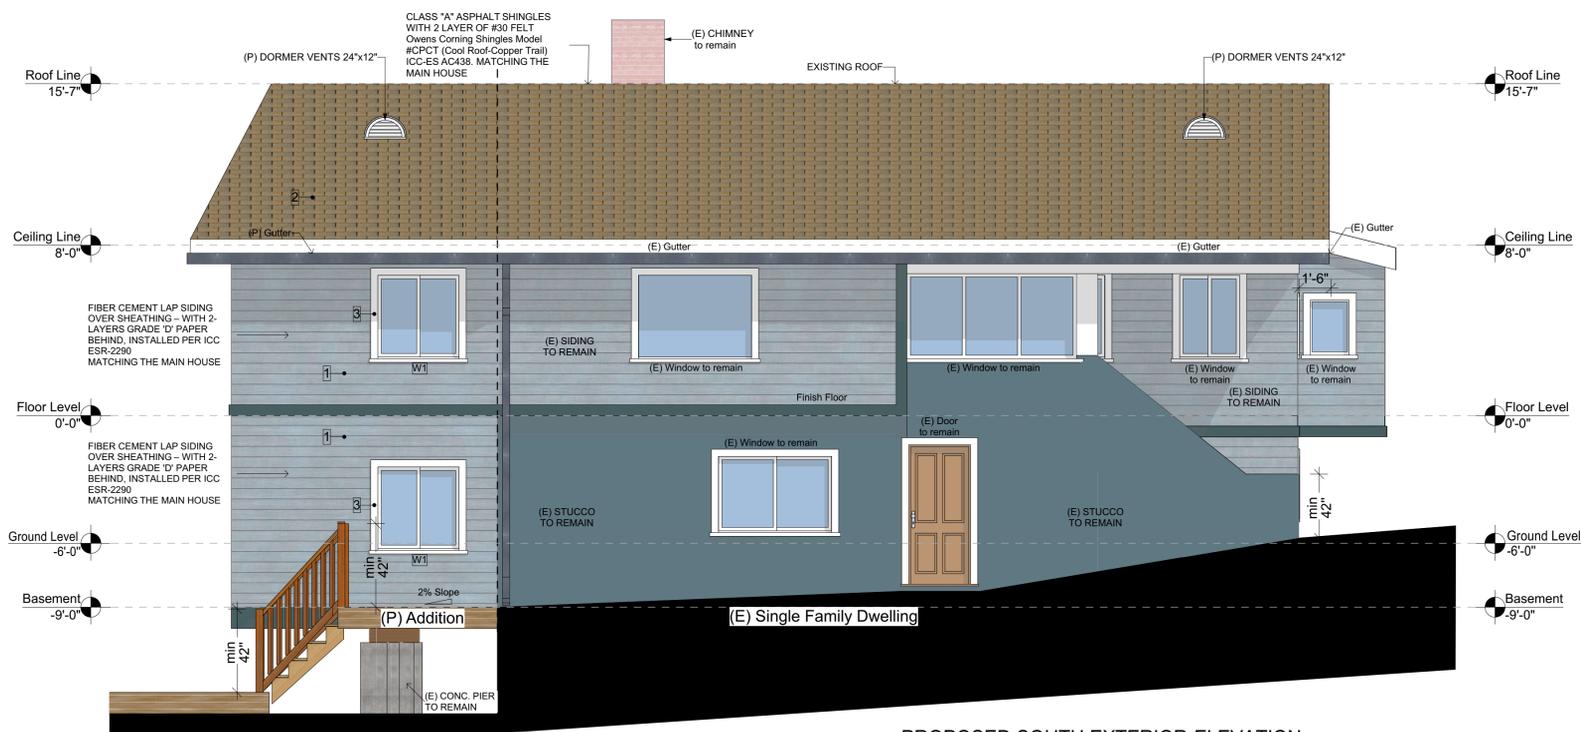

PROPOSED SOUTH EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

LEGEND:

- ⊗ DOOR SYMBOL
- ⊗ WINDOW SYMBOL
- ⊕ HIGH LEVEL
- ⊗ ELEVATION COLOR BOARD CALLOUT

ELEVATION COLOR BOARD:

No	Finish Material	Color Sample	Code
1	Exterior wall siding		Fiber Cement Siding Finish: Glidden Premium PPG1153-6 "Blue Fjord", Flat Exterior Latex Paint
2	Roof finishing		Asphalt Shingles Owens Corning Shingles Model #DC59 (Cool Roof-Copper Trail)
3	Windows frame paint		PPG - Glidden PPG - Glidden Delicate White #PPG1001-1

The proposed Addition stucco/siding color and texture to match the Existing Single Family Dwelling existing stucco/siding color and texture. The proposed Addition roofing material and color to match Existing Single Family Dwelling roofing material and color.

GENERAL NOTES:

- Sills and sleepers on a concrete or masonry slab that is in direct contact with the ground unless separated from such slab by an impervious moisture barrier. CRC R317.1, item 3
- The ends of wood girders entering exterior masonry or concrete walls having clearances of less than 1/2 inch (12.7 mm) on tops, sides and ends. CRC R317.1, item 4
- Field-cutting ends, notches and drilled holes of preservative-treated wood shall be treated in the field in accordance with AWPAM4. CRC R317.1.1
- Wood framing members that rest on concrete or masonry exterior foundation walls and are less than 8 inches (203 mm) from the exposed ground. CRC R317.1, item 2
- Wood in contact with conc. or masonry must be pressure treated.
- R703.7 Exterior Plaster**
Installation of these materials shall be in compliance with ASTM C926, ASTM C1063 and the provisions of this code.
ASTM C 926, Standard Specification for Application of Portland Cement-Based Plaster.
ASTM C 1063, Standard Specification for Installation of Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster.
- Lathing and plastering materials shall conform to the standards listed in Table 2507.2 and Chapter 35 and, where required for fire protection, shall also conform to the provisions of Chapter 7.
- Gypsum board and gypsum panel products shall conform to the appropriate standards listed in Table 2506.2 and Chapter 35 and, where required for fire protection, shall conform to the provisions of Chapter 7.
- All finish material must meet all application fire, life safety, and building codes.

TABLE 2507.2 LATH, PLASTERING MATERIALS AND ACCESSORIES		TABLE 2506.2 GYPSUM BOARD AND GYPSUM PANEL PRODUCTS MATERIALS AND ACCESSORIES	
MATERIAL	STANDARD	MATERIAL	STANDARD
Accessories for gypsum veneer base	ASTMC1047	Accessories for gypsum board	ASTM C1047
Blended cement	ASTM C595	Adhesives for fastening gypsum board	ASTM C557
Cold-formed steel studs and track, structural	AISI S240	Cold-formed steel studs and track, structural	AISI S200 and ASTM C955, Section 8
Cold-formed steel studs and track, nonstructural	AISI S220	Cold-formed steel studs and track, non structural	AISI S220 and ASTM C645, Section 10
Exterior plaster tending compounds	ASTM C932	Cold-formed steel studs and track, non structural	AISI S220 and ASTM C645, Section 10
Hydraulic cement	ASTMC1157; C1600	Elastomeric joint sealants	ASTM C920
Gypsum casting and molding plaster	ASTM C59	Expandable foam adhesives for fastening gypsum wallboard	ASTM D6464
Gypsum Keene's cement	ASTM C61	Factory-laminated gypsum panel products	ASTM C1766
Gypsum plaster	ASTM C28	Fiber-re inforced gypsum panels	ASTM C1278
Gypsum veneer plaster	ASTM C587	Glass mat gypsum backing panel	ASTM C1178
Interior bonding compounds, gypsum	ASTM C631	Glass mat gypsum panel 5	ASTM C1658
Lime plasters	ASTM C5, C206	Glass mat gypsum substrate	ASTM C1177
Masonry cement	ASTM C91	Joint reinforcing tape and compound	ASTM C474; C475
Metal lath	ASTM C847	Nails for gypsum boards	ASTM C514, F547, F1667
Plaster aggregates	ASTM C35; C897	Steel screws	ASTM C954; C1002
Sand	ASTM C35	Standard specification for gypsum board	ASTM C1396
Perlite	ASTM C35	Testing gypsum and gypsum products	ASTM C22, C472; C473
Vermiculite	ASTM C35	Welded wire lath	ASTM C933
Plastic cement	ASTM C1328	Woven wire plaster base	ASTM C1032
Portland cement	ASTM C150		
Steel screws	ASTM C1002; C954		

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONNING: R-4
CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

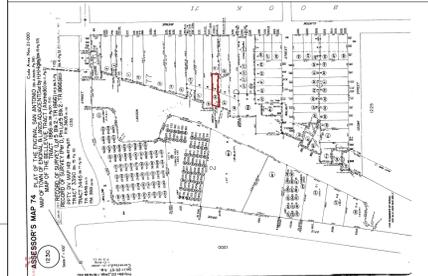

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

DESIGN STAGE

DESIGNER:

(213) 618-5456
ANDREW ATAMANIUK
permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com


SITE:
2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501

TITLE:
(E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF TOTAL 1,936.8 SF


ELEVATIONS

SCALE AT ARCH D: 1/4"-1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO: **A13.1**

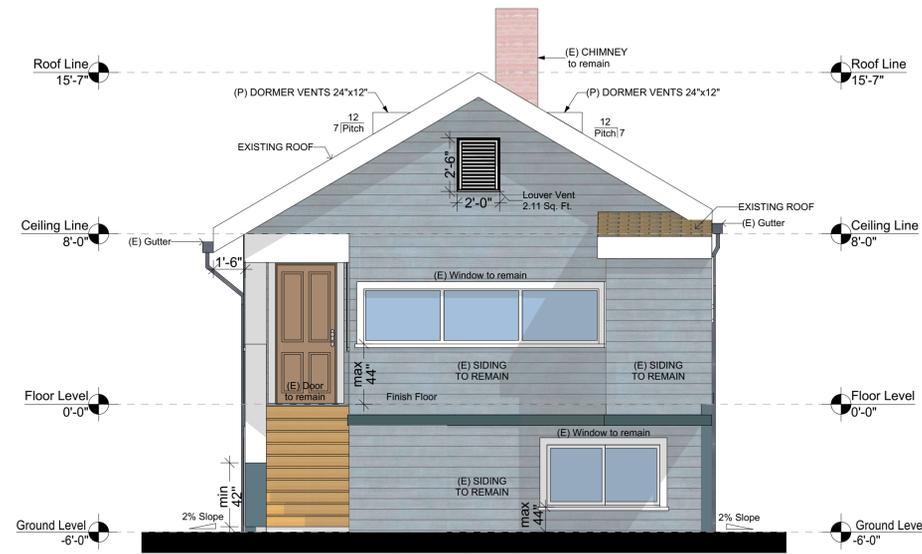

(E) Single Family Dwelling
PROPOSED EAST EXTERIOR ELEVATION
 SCALE: 1/4" = 1'-0"

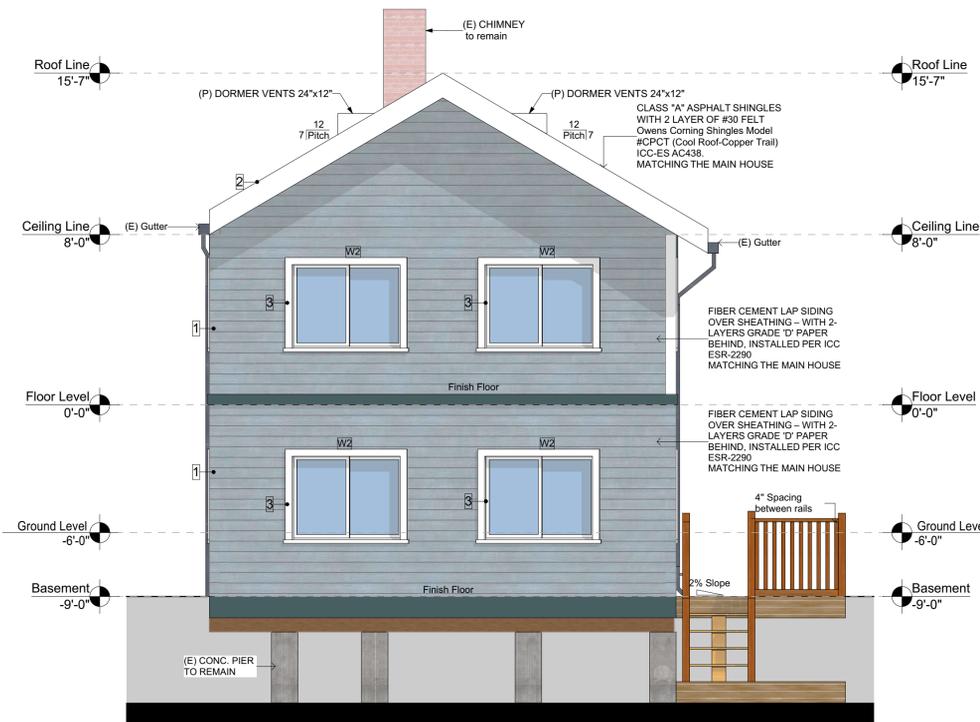

(P) Addition
PROPOSED WEST EXTERIOR ELEVATION
 SCALE: 1/4" = 1'-0"

LEGEND:

- ⊗ DOOR SYMBOL
- ⊠ WINDOW SYMBOL
- ⬆ HIGH LEVEL
- ⊠ ELEVATION COLOR BOARD CALLOUT

ELEVATION COLOR BOARD:

№	Finish Material	Color Sample	Code
1	Exterior wall siding		Fiber Cement Siding Finish: Glidden Premium PPG1153-6 "Blue Fjord", Flat Exterior Latex Paint
2	Roof finishing		Asphalt Shingles Owens Corning Shingles Model #DC59 (Cool Roof-Copper Trail)
3	Windows frame paint		PPG - Glidden PPG - Glidden Delicate White #PPG1001-1

The proposed Addition stucco/siding color and texture to match the Existing Single Family Dwelling exterior stucco/siding color and texture. The proposed Addition roofing material and color to match Existing Single Family Dwelling roofing material and color.

GENERAL NOTES:

Sills and sleepers on a concrete or masonry slab that is in direct contact with the ground unless separated from such slab by an impervious moisture barrier. CRC R317.1, item 3
 The ends of wood girders entering exterior masonry or concrete walls having clearances of less than 1/2 inch (12.7 mm) on tops, sides and ends. CRC R317.1, item 4
 Field-cutting ends, notches and drilled holes of preservative-treated wood shall be treated in the field in accordance with AWPAM4. CRC R317.1.1
 Wood framing members that rest on concrete or masonry exterior foundation walls and are less than 8 inches (203 mm) from the exposed ground. CRC R317.1, item 2

Wood in contact with conc. or masonry must be pressure treated.

R703.7 Exterior Plaster

Installation of these materials shall be in compliance with ASTM C926, ASTM C1063 and the provisions of this code.
 ASTM C 926, Standard Specification for Application of Portland Cement-Based Plaster.
 ASTM C 1063, Standard Specification for Installation of Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster.

Lathing and plastering materials shall conform to the standards listed in Table 2507.2 and Chapter 35 and, where required for fire protection, shall also conform to the provisions of Chapter 7.

Gypsum board and gypsum panel products shall conform to the appropriate standards listed in Table 2506.2 and Chapter 35 and, where required for fire protection, shall conform to the provisions of Chapter 7.

All finish material must meet all application fire, life safety, and building codes.

TABLE 2507.2 LATH, PLASTERING MATERIALS AND ACCESSORIES		TABLE 2506.2 GYPSUM BOARD AND GYPSUM PANEL PRODUCTS MATERIALS AND ACCESSORIES	
MATERIAL	STANDARD	MATERIAL	STANDARD
Accessories for gypsum veneer base	ASTMC1047	Accessories for gypsum board	ASTM C1047
Blended cement	ASTM C595	Adhesives for fastening gypsum board	ASTM C557
Cold-formed steel studs and track, structural	AISI S240	Cold-formed steel studs and track, nonstructural	AISI S200 and ASTM C955, Section 8
Cold-formed steel studs and track, nonstructural	AISI S220	Cold-formed steel studs and track, non structural	AISI S220 and ASTM C645, Section 10
Exterior plaster tending compounds	ASTM C932	Elastomeric joint sealants	ASTM C920
Hydraulic cement	ASTMC1157; C1600	Expandable foam adhesives for fastening gypsum wallboard	ASTM D6464
Gypsum casting and molding plaster	ASTM C59	Factory-laminated gypsum panel products	ASTM C1766
Gypsum Keene's cement	ASTM C61	Fiber-re inforced gypsum panels	ASTM C1278
Gypsum plaster	ASTM C28	Glass mat gypsum backing panel	ASTM C1178
Gypsum veneer plaster	ASTM C587	Glass mat gypsum panel 5	ASTM C1658
Interior bonding compounds, gypsum	ASTM C631	Glass mat gypsum substrate	ASTM C1177
Lime plasters	ASTM C5, C206	Joint reinforcing tape and compound	ASTM C474; C475
Masonry cement	ASTM C91	Nails for gypsum boards	ASTM C514, F547, F1667
Metal lath	ASTM C847	Steel screws	ASTM C954; C1002
Plaster aggregates	ASTM C35; C897	Standard specification for gypsum board	ASTM C1396
Sand	ASTM C35	Testing gypsum and gypsum products	ASTM C22, C472; C473
Perlite	ASTM C35	Welded wire lath	ASTM C933
Vermiculite	ASTM C35	Woven wire plaster base	ASTM C1032

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
 APN #: 074-1230-020-00
 ZONNING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

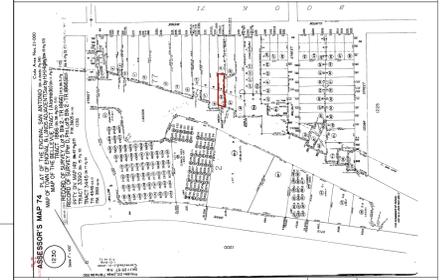

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: **DESIGN STAGE**

DESIGNER:

(213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT: Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com


SITE: 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE: (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE: **ELEVATIONS**

SCALE AT ARCH D: 1/4"-1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO: **A13.2**

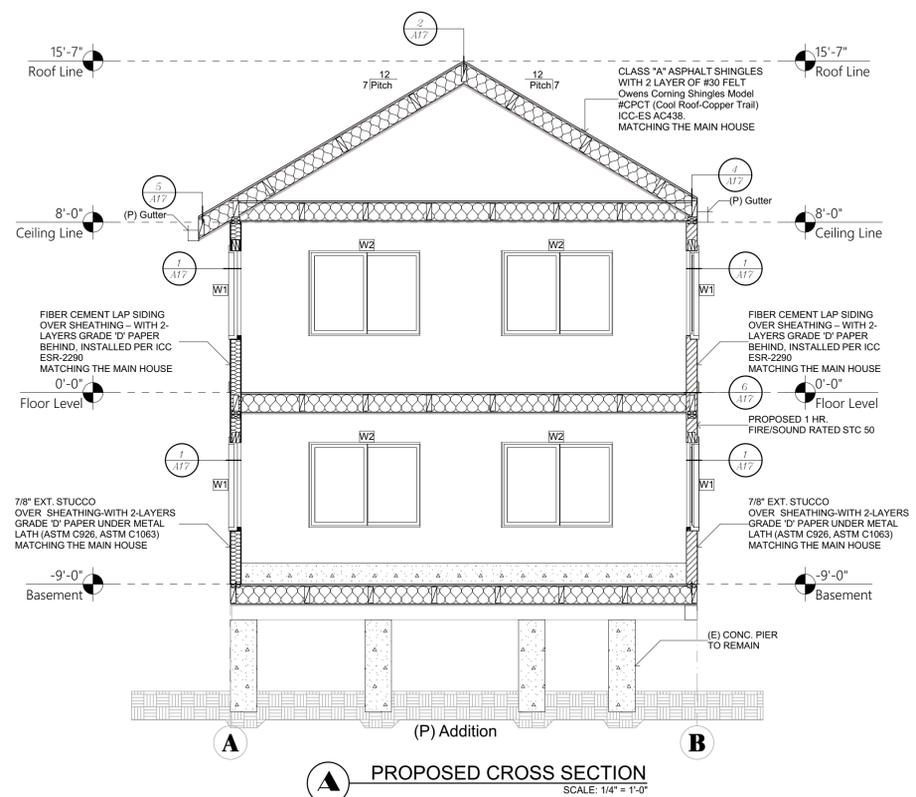

PROPOSED CROSS SECTION
SCALE: 1/4" = 1'-0"

LEGEND:

- ⊗ DOOR SYMBOL
- ⊗ WINDOW SYMBOL
- ⊙ HEIGHT LEVEL
- ▨ INSULATION
- ⊗ DETAIL CALLOUT
- ▨ PROPOSED 1 HR. FIRE/SOUND RATED STC 50

LOUVER VENT SPACE CALCULATIONS:

Louver vent calculations:
Total addition area 776/150 = 5.17 SF ventilation

Sym.	Size	Net Area	Quantity	Total
	24"x30"	2.12 SF	1	5.0 SF
	24"x12"	0.69 SF	4	2.76 SF

Proposed vents area: 5.0+0.69x4 = 7.76 SF
Minimum required vents area: 776/150 = 5.17 SF
5.17 < 7.76 OK

VENT NOTES:

The net free ventilating area of enclosed attics and enclosed rafter spaces shall not be less than 1/150 of the area of the space ventilated, except that reduction of total the area to 1/300 is permitted provided that at least 40% and not more than 50% of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated and not more than 3 ft.

Below the ridge or highest point of the space measured vertically with the balance of the required ventilation provided by eave or cornice vents. a minimum of 1-inch clearance shall be provided between the insulation and roof sheathing.



PRODUCT:
24 inch WIDE X 30 inch HIGH Louver Exterior Wall Vent, FLUSH Mount, 30 Gauge Galvanized Steel. Fits into a 24 x 30 inch cut opening. 305 Sq.In. Net Free Vent Area. Made in USA. Price/Each.

ORDERING NOTES:
• Shipping leadtime: 2-4 days.

DESCRIPTION:
Louvered exterior wall vent is designed for FLUSH mounting to existing surfaces. The special louvered design resists wind blown rains and provide good attic ventilation. Interior base area has an incidental water collection design which drains to face. Made in USA with 30 Gauge G90 Galvanized Steel.


FEATURES:
• Application: Designed to be mounted in a flat exterior building wall in the gable area.
• Construction: All galvanized steel construction (paintable with any house paint).
• Screen: Louvers are backed with #4 (1/4 inch) mesh galvanized steel hardware screen.
• Venting: Approx. 305 sq.in. net free air (highest venting area in its class).
• Flange: 1-1/2 inch flange all around louver.
• Louvers: 1/2 inch undersized from call-out dimensions.
• Rough opening: call-out size

OPTIONS:
• Sizes: widths and heights from 10 inches to 48 inch
• Mount: Flush or Recessed Mount (under stucco type)
• Shape: Square, Round, Triangular, Rounded Top, Others

GIBRALTAR BUILDING PRODUCTS

SPECIFICATIONS DORMER VENTS

#BH24	#BH24-1/8
#LPDG19	#LPDH18
#LPSD20	#STD24-2B

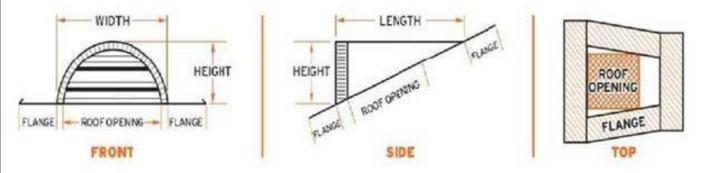

DORMER VENTS

PART#	DESCRIPTION	HEIGHT	WIDTH	ROUGH OPENING	N.F.V.
BH24	12 x 24 Square Tail	12"	24"	12" x 9"	106 sq. in.
BH24-1/8	12 x 24 Square Tail - 1/8 in. screen	12"	24"	12" x 9"	106 sq. in.
LPDG15	19" Low Profile	4"	19"	19" x 10"	43 sq. in.
LPDH18	18" Low Profile	7"	18"	18" x 10"	81 sq. in.
LPSD20	20" Low Profile (Simpson)	2.75"	20"	19" x 10"	48 sq. in.
STD24-2B	12 x 24 Soft Aluminum - 2 Sides	12"	24"	12" x 9"	106 sq. in.



GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONNING: R-4
CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

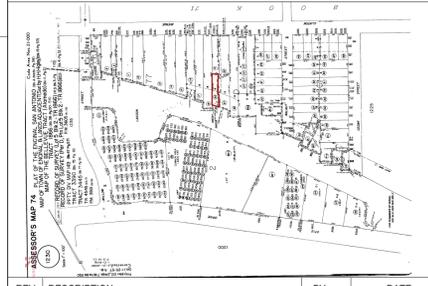

REV.	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: DESIGN STAGE

DESIGNER:

ANDREW ATAMANIUK
permits@atamanstudio.com
ATAMAN STUDIO

CLIENT:
Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com


SITE:
2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501

TITLE:
(E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF TOTAL 1,936.8 SF


CROSS SECTIONS

SCALE AT ARCH D: 1/4"-1'-0"
DATE: 12/24/2025

PROJECT NO:
DRAWING NO: **A14**

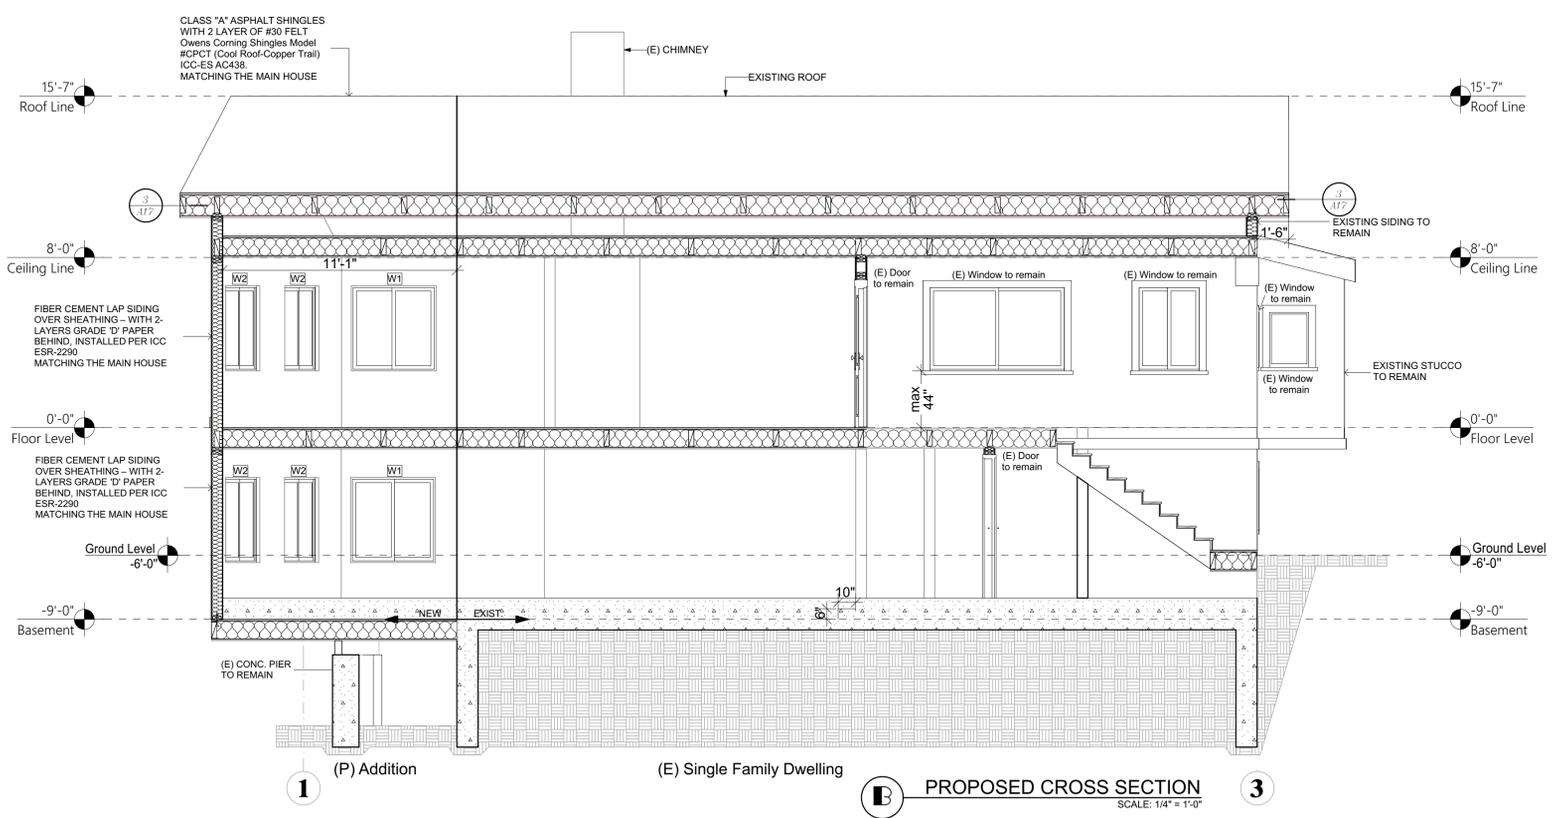

PROPOSED CROSS SECTION
SCALE: 1/4" = 1'-0"

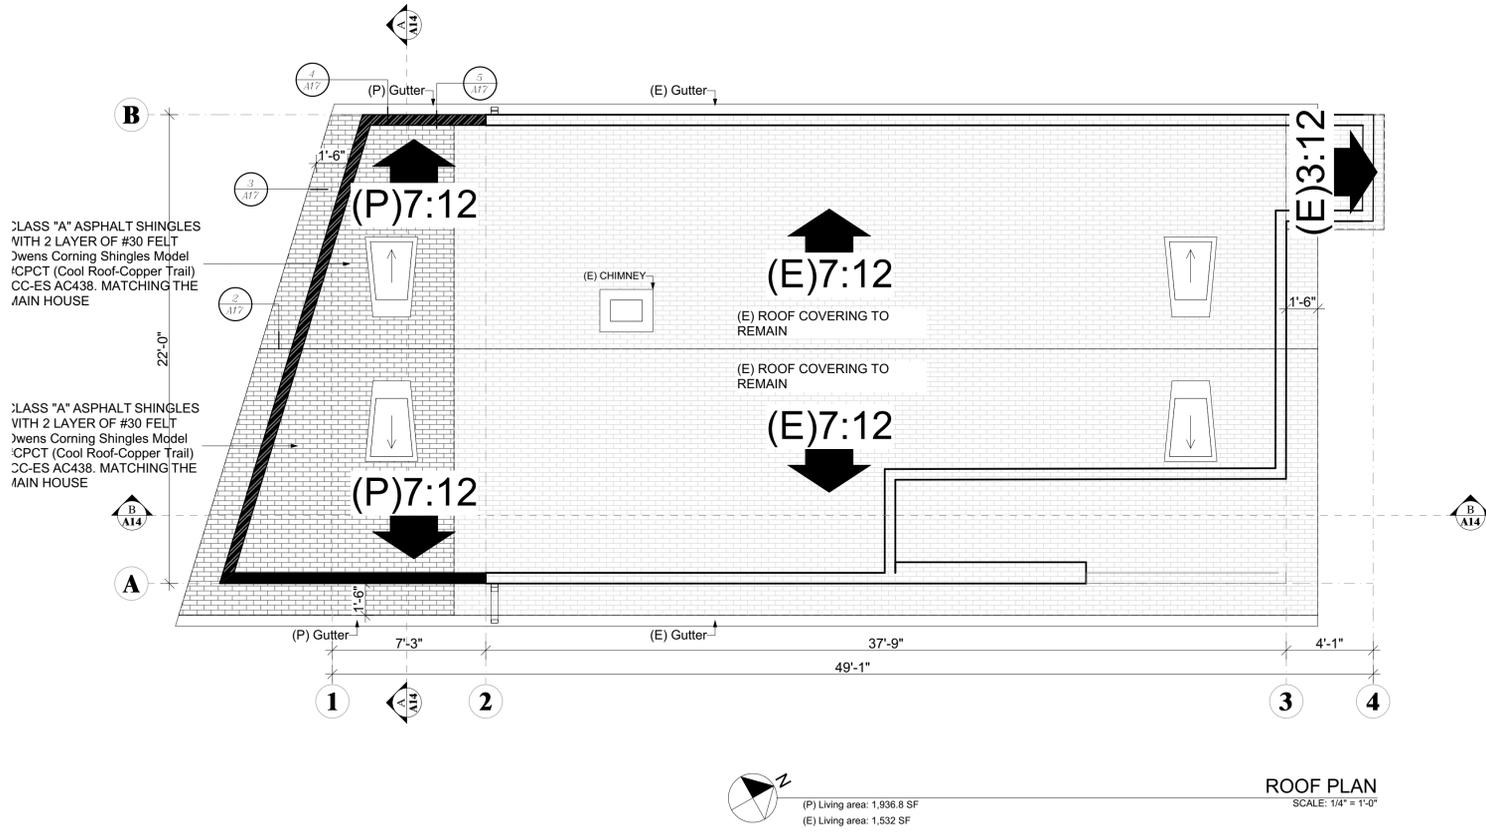

LEGEND:

- 3:12** ROOF SLOPE
- (P) ROOF COVERING
- (E) ROOF COVERING
- DETAIL CALLOUT
- (P) DORMER VENTS 24"x12"

WALL TYPES:

- EXISTING WALLS
- PROPOSED WALLS
- PROPOSED 1 HR. FIRE/SOUND RATED STC 50

ROOF COVERING:

2. CLASS "A" ASPHALT SHINGLES WITH 2 LAYER OF #30 FELT Owens Corning Shingles Model #CPCT (Cool Roof-Copper Trail) ICC-ES AC438. MATCHING THE MAIN HOUSE

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.

THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONNING: R-4
CONSTRUCTION TYPE: TYPE V-B


BLANK SPACE FOR APPROVAL STAMP

COOL Roof Collection

Colors	CRRC PRODUCT ID	SOLAR REFLECTANCE	THERMAL EMITTANCE	SOLAR REFLECTANCE INDEX (SRI)	
Woodmoor, and Woodcrest	Forest Brown	0890-0024	0.170	0.9200	16††
	Mountainside	0890-0027	0.190	0.9000	18††
	Night Sky	0890-0028	0.190	0.9000	18††
	Sand Castle	0890-0029	0.180	0.9000	16††
	Summerwood	0890-0025	0.170	0.9100	16††
TruDefinition™ Duration MAX	Forest Brown ^{AA}	0890-0018A	0.180	0.9100	17††
	Mountainside ^{AA}	0890-0016A	0.190	0.9200	19††
	Night Sky ^{AA}	0890-0026	0.180	0.9000	16††
	Sand Castle ^{AA}	0890-0020	0.17	0.92	16
Duration™ Premium COOL	Frosted Oak ^{AA}	0890-0005	0.28	0.91	30
	Harbor Fog ^{AA}	0890-0004	0.30	0.90	32
	Sage ^{AA}	0890-0003	0.29	0.88	30
TruDefinition™ Duration™ COOL Plus	Sunrise ^{AA}	0890-0006	0.28	0.91	30
	Cliffside Gray ^{AA}	0890-0031	0.210	0.9100	21††
	Copper Trail ^{AA}	0890-0030	0.210	0.9200	21††
	Golden Meadow ^{AA}	0890-0033	0.210	0.9400	22††
	Mystic Gray ^{AA}	0890-0032	0.210	0.9300	22††
Rolling Stone ^{AA}	Prairie Wood ^{AA}	0890-0035	0.200	0.9200	20††
	Rolling Stone ^{AA}	0890-0034	0.210	0.9300	22††

20+ SRI

ASSESSOR'S MAP

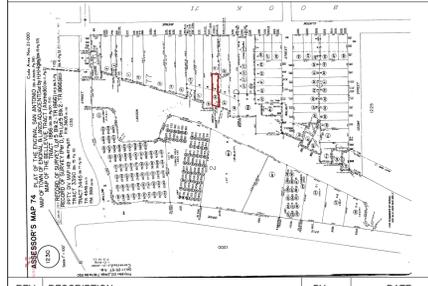

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: **DESIGN STAGE**

DESIGNER: *Andrew Atamaniuk*
(213) 618-5456
ANDREW ATAMANIUK
permits@atamanstudio.com
ATAMAN STUDIO

CLIENT: Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com


SITE: 2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501

TITLE: (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
TOTAL 1,936.8 SF

DRAWING TITLE: **ROOF PLAN**


SCALE AT ARCH D: 1/4"-1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO: **A15**

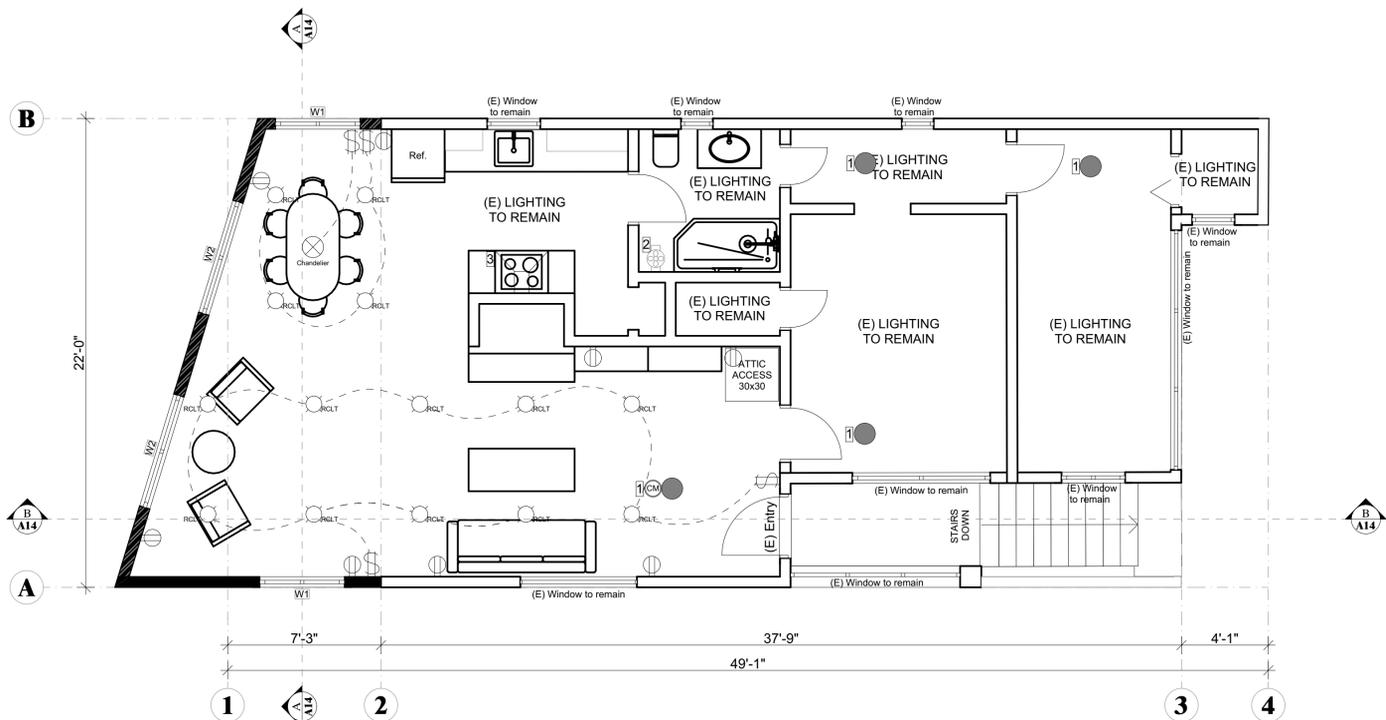

PROPOSED FIRST FLOOR ELECTRICAL LAYOUT
SCALE: 1/4" = 1'-0"

(E) First floor area: 776 SF
(P) Addition to first floor: 202.4 SF

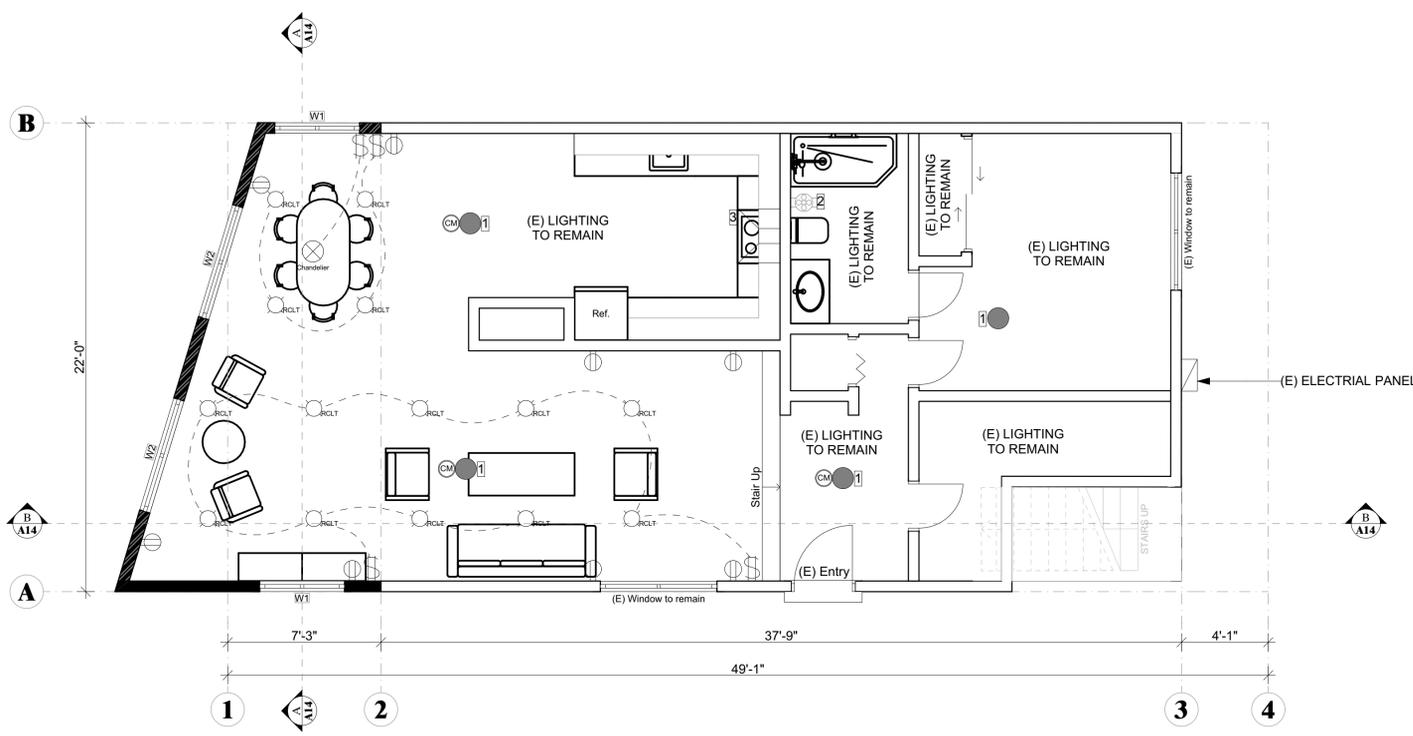

PROPOSED BASEMENT FLOOR ELECTRICAL LAYOUT
SCALE: 1/4" = 1'-0"

(E) Basement floor area: 756 SF
(P) Addition to basement floor: 202.4 SF

LEGEND:

	CARBON MONOXIDE DETECTOR (STATE APPROVED) HARD WIRED STATE FIRE MARSHALL APPROVED WITH BATTERY BACKUP W/LOW BATTERY SIGNAL.
	SMOKE (STATE APPROVED) HARD WIRED STATE FIRE MARSHALL APPROVED WITH BATTERY BACKUP W/LOW BATTERY SIGNAL.
	EXHAUST FAN 1. FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE TO THE OUTSIDE OF THE BUILDING. 2. FANS, NOT FUNCTIONING AS A COMPONENT OF THE BUILDING HOUSE VENTILATION SYSTEM, MUST BE CONTROLLED BY A HUMIDITY CONTROL.
	RECESSED LIGHT
	DOUPLEX RECEPTACLE OUTLET
	CEILING CHANDELIER
	SWITCH WITH DIMMING CONTROL (ALL EXCEPT LIGHTING CONTROLLED BY OCCUPANCY OR VACANCY SENSOR)

KEYNOTES:

- 1 R314.3 Location
Smoke alarms shall be installed in the following locations:
1. In each sleeping room.
2. Outside each separate sleeping area in the immediate vicinity of the bedrooms.
3. On each additional story of the dwelling, including basements and habitable attics and not including crawl spaces and uninhabitable attics. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.
4. Not less than 3 feet (914 mm) horizontally from the door or opening of a bathroom that contains a bathtub or shower unless this would prevent placement of a smoke alarm required by this section.
5. In the hallway and in the room open to the hallway in dwelling units where the ceiling height of a room open to a hallway serving bedrooms exceeds that of the hallway by 24 inches (610 mm) or more.
- R315.3 Location
Carbon monoxide alarms in dwelling units shall be installed and maintained in accordance with the manufacturer's published instructions in the following locations:
1. Outside of each separate sleeping area in the immediate vicinity of the bedrooms.
2. On every occupiable level of a dwelling unit, including basements.
3. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom.
Smoke detector UL217 . Carbon monoxide detector UL2034/2075
- 2 Provide Mechanical ventilation providing 7 1/2 air changes per hour (50 CFM Min. Rate) Energy Star with humidity control @ detach to terminate building
- 3 Kitchen hood with 100 CFM over the stove.

GENERAL NOTES:

All sections reference the 2020 National Electrical Code unless otherwise note.
All new lighting installed in residential units is required to be rated as high efficacy as required by section 150.0(k), Table 150.0-A. At least one luminaire installed in bathrooms, laundry rooms, and utility rooms shall be controlled by a vacancy sensor per 150.0(k)(2)(J)
UFER GEC is required and a main bonding jumper shall not be installed in the subpanel.

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONING: R-4
CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

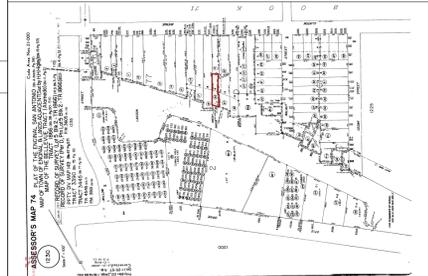

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			
4			

STATUS: DESIGN STAGE

DESIGNER:

(213) 618-5456
ANDREW ATAMANIUK
permits@atamanstudio.com

ATAMAN STUDIO

CLIENT:
Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com

SITE:
2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501


TITLE:
(E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
TOTAL 1,936.8 SF

DRAWING TITLE:
**PROPOSED FIRST FLOOR ELECTRICAL LAYOUT
PROPOSED BASEMENT FLOOR ELECTRICAL LAYOUT**


SCALE AT ARCH D: 1/4" = 1'-0" DATE: 12/24/2025

PROJECT NO: DRAWING NO:

A16

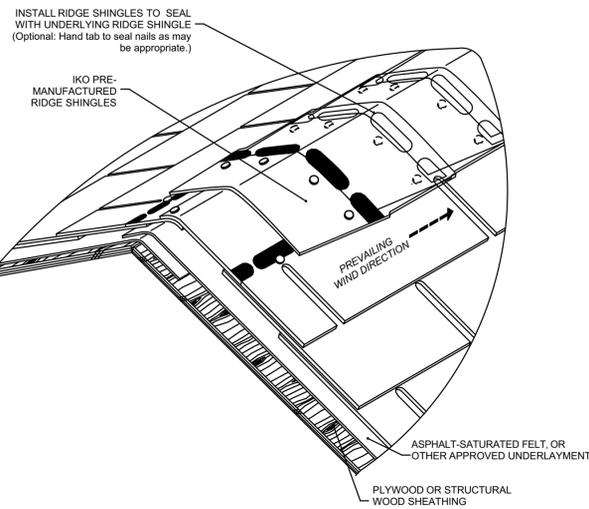

- NOTES:**
- In cold climates, where snow and ice are common, an Ice & Water Protector membrane, such as IKOArmourguard or Stormshield, is recommended as an ice-dam protection membrane at all potential icedamming locations such as downslope eaves, valleys, crickets, around penetrations, and rakeedges. Consult local Building Code requirements.
 - To determine need for airflow and/or ventilation, including vent sizes/needs, refer to local building codes.
 - Consider specifying hip and ridge shingles to be field-cut from full width 3-tab shingles, as they may provide for more coverage or overlap of the underlying field course of shingles.
 - Dimensions shown are recommended minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.
 - The profile of specific components, their configuration or sequencing, can vary with the roof system, with climatic differences, and regional or area practices.

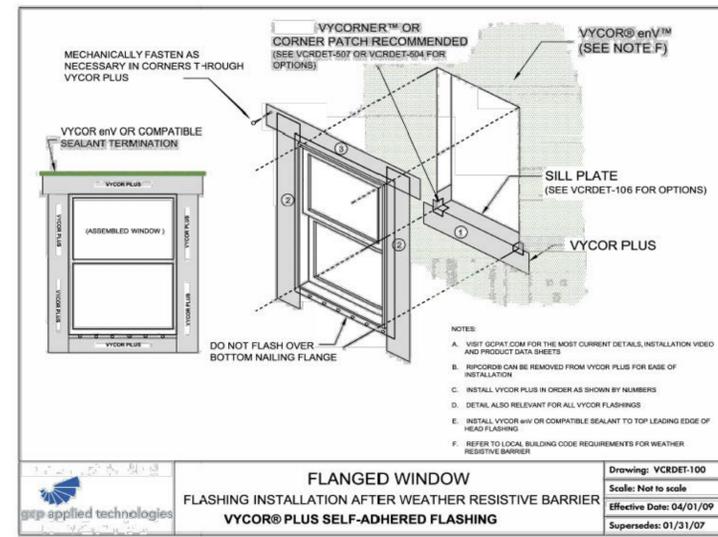

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:


LOT #: 20
 APN #: 074-1230-020-00
 ZONING: R-4
 CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP


2 ROOF RIDGE DETAIL (TYP)

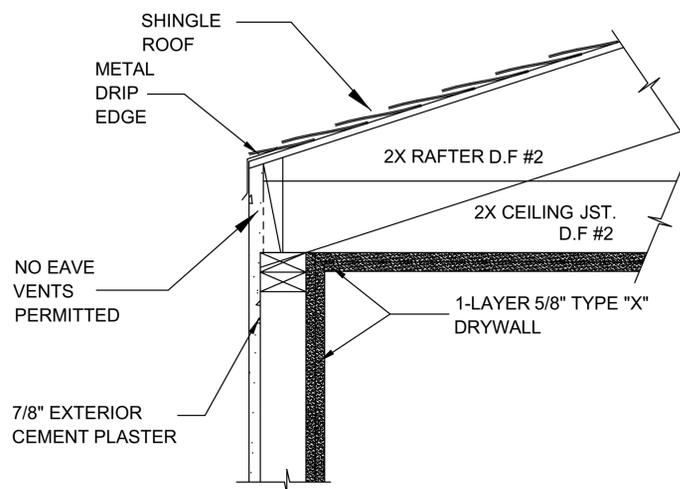


1 TYPICAL DETAIL

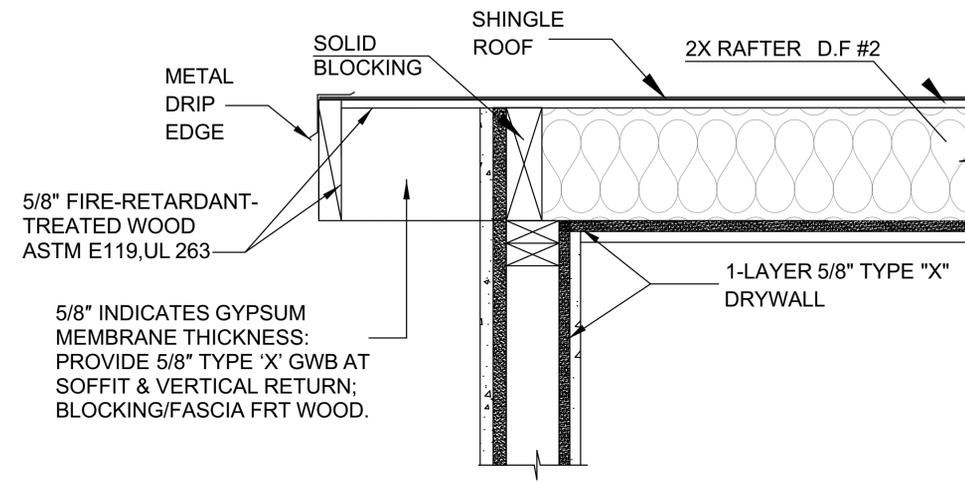

ASSESSOR'S MAP

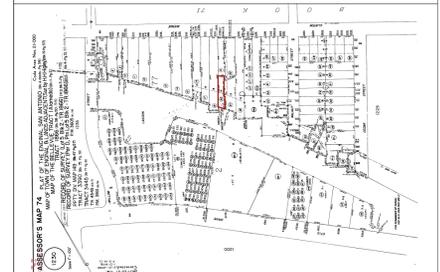


4 1-HOUR FIRE WALL (NO EAVE)

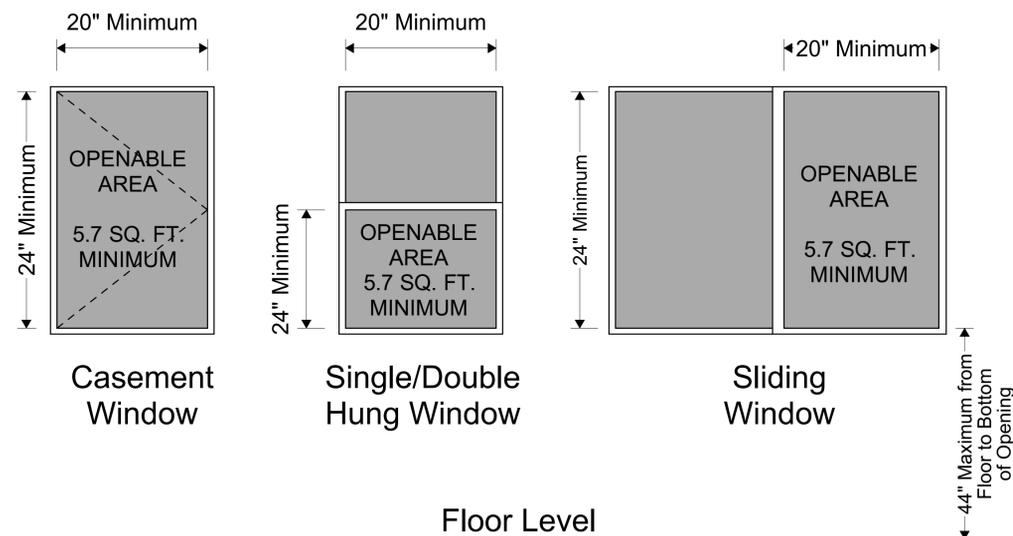

All Emergency Escape and Rescue Openings require a minimum 5.7 SQ.FT. of clear opening area, except grade-floor openings are permitted to be a minimum of 5 SQ.FT. in area.

3 1-HOUR FIRE EAVE

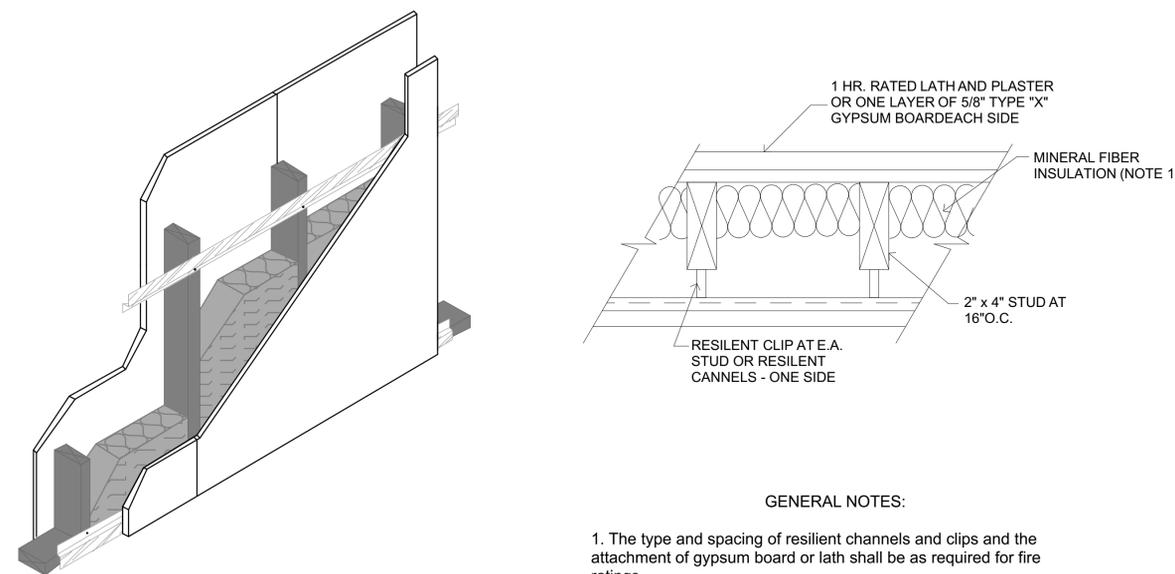

GENERAL NOTES:

- The type and spacing of resilient channels and clips and the attachment of gypsum board or lath shall be as required for fire ratings.
- The mineral fiber insulation shall have a thermal resistance R value of 11 or greater as determined by Federal Specification RR-1-521B.
- No test is on file to justify an STC 50 with one 5/8" type "X" gypsum board each side.

Framing: 2x4 wood studs, 16" o.c.
 Insulation: 3-1/2" glass fiber
 Side 1: 5/8" Fire-Shield Gypsum Board
 Side 2: 5/8" Fire-Shield Gypsum Board on RC-1

REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: **DESIGN STAGE**

DESIGNER: *Andrew Atamaniuk*
 (213) 618-5456
 ANDREW ATAMANIUK
 permits@atamanstudio.com
ATAMAN STUDIO

CLIENT: Meghan Noonan
 (301) 305-0866
 Meghannoonan@yahoo.com

SITE: 2146 1/2 CLINTON AVE,
 ALAMEDA, CA 94501

TITLE: (E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
 TOTAL 1,936.8 SF

DRAWING TITLE: **ARCHITECTURAL DETAILS**

SCALE AT ARCH D: DATE: 12/24/2025
 PROJECT NO: DRAWING NO:

6 EMERGENCY EGRESS FROM BEDROOM

5 1HR-FIRE/SOUND RATED WALL

A17

CONSTRUCTION REQUIREMENTS

2. Notching of studs in exterior or bearing walls shall not exceed 25% of its width. Notching of studs in nonbearing walls shall not exceed 40% of its width. Bored holes in studs shall not exceed 60% of its width, shall not be closer than 5/8" to the edge of the stud, and shall not be located in the same section as a cut or notch. Studs located in exterior or bearing walls shall be doubled if bored over 40% and up to 60% of its width. (R 602.6)

3. Wall and Ceiling finishes shall have a flame spread index of not greater than 200, and a smoke-developed index not greater than 450. Insulation materials shall have a flame spread index not to exceed 25, and a smoke-developed index not to exceed 450. (R 302.9, 302.10)

4. Provide fire blocking in concealed spaces of combustible stud walls, partitions, including furred spaces, at the ceiling and floor level, at 10-foot intervals both vertical and horizontal, and between stair stringers at the top and bottom. (R 302.11)

5. Ducts installed under a floor in a crawl space shall not prevent access to an area of the crawl space. Where it is required to move under ducts for access to areas of the crawl space, a vertical clearance of 18" minimum shall be provided. (MC 603.1)

6. Where flashing is of metal, the metal shall be corrosion resistant with a thickness of not less than .019 inch (No. 26 galvanized sheet). (R 903.2.1)

7. Roof diaphragm nailing to be inspected before covering. Wood structural panel sheathing shall comply with Section R803.2. (R 803)

8. End joints in lumber used as subflooring shall occur over supports, unless end-matched lumber is used, in which case each piece shall bear on not less than two joists. Wood structural panel sheathing used for structural purposes shall comply with Section R503.2. (R 503)

GLAZING REQUIREMENTS

9. The following shall be considered specific hazardous locations requiring safety glazing per Section R308:

a. Glazing in fixed and operable panels of swinging, sliding, and bifold doors.

b. Glazing in fixed or operable panels adjacent to a door where the bottom exposed edge of the glazing is less than 60 inches above the walking surface and it meets either of the following conditions:

1. Where the glazing is within 24 inches of either side of the door in the plane of the door in a closed position.
2. Where the glazing is on a wall perpendicular to the plane of the door in a closed position and within 24 inches of the hinge side on an in-swinging door.

c. Window glazing in an individual fixed or operable panel, that meets all of the following conditions:

1. The exposed area of an individual pane is larger than 9 square feet.
2. The bottom edge is less than 18 inches above the floor.
3. The top edge is more than 36 inches above the floor.
4. One or more walking surfaces are within 36 inches, measured horizontally and in a straight line, of the glazing.

d. Glazing in guards, railings, structural baluster panels, and nonstructural in-fill panels, regardless of area or height above a walking surface.

e. Glazing in walls, enclosures or fences containing or facing hot tubs, spas, whirlpools, saunas, steam rooms, bathtubs, showers, and indoor or outdoor swimming pools, where all of the following conditions are present:

1. The bottom edge of the glazing is less than 60 inches above any standing or walking surface.
2. The glazing is within 60 inches, measured horizontally and in a straight line, from the water's edge of a hot of a shower tub, spa, whirlpool, bathtub, or swimming pool, or from the edge, sauna or steam room.

f. Glazing adjacent to stairs and ramps where the bottom exposed edge is less than 36 inches above the plane of the adjacent walking surface of stairways, landings between flights of stairs, and ramps, unless the glazing is 36 inches or more measured horizontally from the walking surface, or a rail is designed per Section R308.4.6.

g. Glazing adjacent to the landing at the bottom of a stairway where the glazing is less than 36 inches above the landing and within a 60-inch horizontal arc less than 180 degrees from the bottom tread nosing, unless the glazing is more than 18 inches from a protective guard per Section R312.

MECHANICAL/PLUMBING/ELECTRICAL CODE REQUIREMENTS

10. Dwelling shall be provided with comfort heating facilities capable of maintaining a room temperature of 68 degrees F at a point 3 feet above the floor and 2 feet from exterior walls. (R303.9)

11. The following are required for central heating furnaces and low-pressure boilers in a compartment:

a. Listed appliances shall be installed with clearances in accordance with the terms of their listings and the manufacturer's installation instructions. (MC 904.2(1))

b. Unlisted appliances shall meet both the clearances in Table 904.2, and the clearances allowed by the manufacturer's installation instructions. (MC 904.2(2))

c. When combustion air is taken from inside, the free area of combustion air openings shall be 1 sq. inch per 1,000 BTU (100 sq. inch minimum) per opening. One Opening shall be within 12 inches of the top of the enclosure and the second shall be within 12 inches of the bottom of the enclosure. The dimension shall not be less than 3 inches. (MC 701.5(1))

d. Not less than 1/4 of an inch screen mesh is required at openings where combustion air is taken from the outside. (MC 701.10(1)) e. Separate ducts shall be used for upper and lower combustion air openings, and maintained to the source of combustion air. (MC 701.11(4))

12. The following are required for appliances installed in an attic:

a. An opening and passageway shall not be less than 22 inches by 30 inches, and not less than the size of the largest component of the appliance. (MC 304.4)

b. Where the passageway height is less than 6 feet, the distance from access to the appliance shall not exceed 20 feet, as measured along the centerline. (MC 304.4.1)

c. Passageway shall be unobstructed and shall have solid flooring not less than 24 inches wide from entrance to appliance. (MC 304.4.2)

d. A level working platform not less than 30 inches by 30 inches is required in front of the service side of the appliance. (MC 304.4.3)

e. A permanent 120V receptacle outlet and a lighting fixture shall be installed near the appliance. Light switch shall be located at the entrance to the passageway. (MC 304.4.4)

f. A type B or L gas vent shall terminate not less than 5 feet above the highest connected appliance flue collar or draft hood. (MC 802.6.2.1)

g. Appliance installation shall meet all listed clearances. (MC 303.1)

13. Clothes dryer exhaust duct shall terminate on the outside of the building in accordance with Section 502.2.1 and shall be equipped with a back-draft damper. Screens shall not be installed at the duct termination. (MC 504.4)

14. Clothes dryer moisture exhaust duct shall be 4 inches in diameter and is limited to a total combined horizontal and vertical length of 14 feet, including two 90 degree elbows from the clothes dryer to point of termination. Duct length shall be reduced by 2 feet for each 90 degree elbow in excess of two.(MC 504.4.2)

15. Appliances (water heater, furnace, etc.) located in the garage shall be installed so that burners and burnerignition devices are located not less than 18 inches above the floor, unless listed as flammable vapor ignition resistant. (MC 305.1)

16. Ducts shall be sized per Chapter 6 of the Mechanical Code.

17. Flush volumes of plumbing fixtures and flow rates of plumbing fittings shall comply with Section 4.303 of the Green Code.

18. ABS and PVC DWV piping installations are limited to not more than two stories of areas. (PC 701.2(2))

19. All showers and tub-showers shall have a pressure balance, thermostatic, or combination pressure balance/thermostatic mixing type valve. (PC 408.3)

20. All new, replacement and existing water heaters shall be strapped to the wall in two places. One on the upper 1/3 of the tank, and one on the lower 1/3 of the tank. The lower point shall be a minimum of 4 inches above the controls. (PC 507.2)

21. Plumbing plan check and approval is required for 2 inch and larger water lines, 2 inch and larger gas lines, or any gas line with a pressure of 2psi and higher.

22. Ground-fault circuit-interruption (GFCI) for personnel shall be provided in bathrooms, garages, non-habitable accessory structures at or below grade level, outdoor locations, crawl spaces at or below grade level, nonhabitable basements, kitchens where the receptacles serve countertop surfaces, locations within 6ft of the outside edge of sinks/bathtubs/showers, bathhouses, and laundry areas. The GFCI shall be installed in a readily accessible location. (EC 210.8(A))

23. Arc-fault circuit-interruption (AFCI) protection shall be provided in all 120-volt, single phase, 15- and 20ampere branch circuits supplying outlets or devices installed in kitchens, habitable rooms, sunrooms, recreation rooms, closets, hallways, laundry areas, or similar rooms or areas, by any means described in 210.12(A). (EC 210.12(A))

24. In any of the areas specified in item 23, where existing branch-circuit wiring is modified, replaced, or extended by more than 6ft and/or adds any outlet or device, the branch circuit shall be protected by one of the following:

- a. A listed combination-type AFCI located at the origin of the branch circuit.
- b. A listed outlet branch-circuit type AFCI located at the first receptacle outlet of the existing branch circuit. (EC 210.12(B))

25. Tamper-resistant receptacles shall be installed in all areas specified in 210.52, all nonlocking-type 12-volt, 15- and 20-ampere receptacles shall be listed tamperresistant receptacles. (EC 406.12)

26. Where NM cable (Romex) is run across the top of joists and/or where the attic is not accessible by permanent stairs or ladders, protection within 6 feet of the nearest edge of the scuttle or attic entrance shall be provided. (EC 334.23, 320.23(A))

GREEN BUILDING STANDARD CODE

GENERAL REQUIREMENTS

1. Plumbing fixtures and fixture fittings on the plans shall comply with the following flow rates:

- a. Water Closets – 1.28 GPF
- b. Urinals – 0.5 GPF
- c. Wall-mounted urinal – 0.125 GPF
- d. Single showerhead – 2.0 GPM at 80psi
- e. Multiple showerheads – 2.0 GPM at 80psi for all combined showerheads
- f. Lavatory faucets – 1.2 GPM at 60psi
- g. Lavatory faucets in public use areas – 0.5 GPM at 60psi
- h. Metering faucets - .25 gallons per cycle
- i. Kitchen faucets – 1.8 GPM at 60psi (4.303.1)

2. Annular spaces around pipes, electrical cables, conduits, or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry, or a similar method acceptable to the enforcing agency. (4.406.1)

3. Fireplaces shall be direct vent sealed combustion type. Indicate on the plans the manufacturer name and model number. (4.503.1)

4. At the time of rough installation, during storage on the construction site, and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheetmetal, or other acceptable methods to reduce the amount of water, dust and debris which may enter the system. (4.504.1)

5. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19% moisture content. Insulation products which are visibly wet or have high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. (4.505.3)

6. All mechanical exhaust fans in rooms with a bathtub or shower shall comply with the following:

- a. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
- b. Fans must be controlled by a readily accessible humidistat unless functioning as a component of a whole house ventilation system. Humidity control shall be capable of adjustment between a relative humidity range of 50% and 80%. (4.506.1)

7. Adhesives, sealants and caulks shall meet or exceed the standards outlined in Section 4.504.2.1 and comply with the VOC limits in Tables 4.504.1 and 4.504.2 as applicable. (4.504.2.1)

8. Paints and coatings shall meet or exceed the standards outlined in Section 4.504.2.2 and comply with the VOC limits in Table 4.504.3. (4.504.2.2)

9. Aerosol paints and coatings shall meet or exceed the standards outlined in Section 4.504.2.3. (4.504.2.3) 10. All carpet installed in the building interior shall meet all the testing and product requirements of one of the following:

- a. Carpet and Rug Institute's Green Label Plus Program OR
- b. California Department of Public Health Standard Method for the testing of VOC Emissions (Specification 01350) OR
- c. NSF/ANSI 140 at the Gold Level OR
- d. Scientific Certifications Systems Indoor Advantage Gold (4.504.3)

11. All carpet cushion installed in the building interior shall meet the requirements of the Carpet and Rug Institute Green Label Program. Carpet adhesives shall not exceed a VOC limit of 50 g/L. (4.504.3.1, 4.504.3.2)

12. A minimum of 80% of floor area receiving resilient flooring shall comply with one of the following:

- a. Products certified as a Low-Emitting Material in the CHPS High Performance Products Database, OR
- b. Products certified under UL GREENGUARD Gold (Formerly the Greenguard Children & Schools program), OR
- c. RFCI FloorScore program, OR
- d. Meet the California Department of Public Health Standard Method for the testing of VOC Emissions (Specification 01350) (4.504.4)

13. Composite wood products (hardwood plywood, particle board, and MDF) installed on the interior or exterior of the building shall meet or exceed the standards outlined in Table 4.504.5. Verification of compliance with these sections must be provided at the time of inspection. (4.504.5)

TABLE 4.504.3/TABLE 5.504.4.3 VOC CONTENT LIMITS FOR ARCHITECTURAL COATING ^{2,3} Grams of VOC per Liter of Coating, Less Water and Less Exempt Compounds			
COATING CATEGORY	VOC LIMIT	COATING CATEGORY	VOC LIMIT
Flat coatings	50	Magnesite cement coatings	450
Nonflat coatings	100	Mastic texture coatings	100
Nonflat high-gloss coatings	150	Metallic pigmented coatings	500
SPECIALTY COATINGS		Multi-color coatings	250
Aluminum roof coating	400	Pretreatment wash primers	420
Basement specialty coatings	400	Primers, sealers, and undercoaters	100
Bituminous roof coatings	50	Reactive penetrating sealers	350
Bituminous roof primers	350	Recycled coatings	250
Bond breakers	350	Roof coatings	50
Concrete curing compounds	350	Rust preventative coatings	250
Concrete/masonry sealers	100	Shellacs: Clear Opaque	730 550
Driveway sealers	50	Specialty primers, sealers and undercoaters	100
Dry fog coatings	150	Stains	250
Faux finishing coatings	350	Stone consolidants	450
Fire resistive coatings	350	Swimming pool coatings	340
Floor coatings	100	Traffic marking coatings	100
Form-release compounds	250	Tub and tile refinish coatings	420
Graphic arts coatings (sign paints)	500	Waterproofing membranes	250
High-temperature coatings	420	Wood coatings	275
Industrial maintenance coatings	250	Wood preservatives	350
Low solids coatings ¹	120	Zinc-rich primer	340

1. Grams of VOC per liter of coating, including water and including exempt compounds.
2. The specified limits remain in effect unless revised limits are listed in subsequent columns in the table.
3. Values in this table are derived from those specified by the California Air Resources Board, Architectural Coatings Suggested Control Measure, February 1, 2005. More information is available from the Air Resources Board.

TABLE 4.504.5/TABLE 5.504.4.5 FORMALDEHYDE LIMITS ¹ Maximum Formaldehyde Emissions in Parts per Million	
PRODUCT	CURRENT LIMIT
Hardwood plywood veneer core	0.05
Hardwood plywood composite core	0.05
Particleboard	0.09
Medium density fiberboard	0.11
Thin medium density fiberboard ²	0.13

1. Values in this table are derived from those specified by the California Air Resources Board, Air Toxics Control Measure for Composite Wood as tested in accordance with ASTM E 1333. For additional information, see California Code of Regulations, Title 17, Section 93120 through 93120.12.
2. Thin medium density fiberboard has a maximum thickness 5/16 inch (3mm).

TABLE 4.504.2/TABLE 5.504.4.2 SEALANT VOC LIMIT Less Water and Less Exempt Compounds in Grams Per Liter	
SEALANTS	VOC LIMIT
Architectural	250
Marine deck	760
Nonmembrane roof	300
Roadway	250
Single-ply roof membrane	450
Other	420

SEALANT PRIMERS	
Architectural	Porous
250	775
Modified bituminous	500
Marine deck	760
Other	750

Note: For additional information regarding methods to measure the VOC content specified in this table, see South Coast Air Quality Management District Rule 1168

TABLE 4.504.1/TABLE 5.504.4.1 ADHESIVE VOC LIMIT ^{1,2} Grams of VOC per Liter of Coating, Less Water and Less Exempt Compounds	
ARCHITECTURAL APPLICATIONS	VOC LIMIT
Indoor carpet adhesives	50
Carpet pad adhesives	50
Outdoor carpet pad adhesives	150
Wood flooring adhesives	100
Rubber floor adhesives	80
Subfloor adhesives	80
Ceramic tile adhesives	85
VCT and asphalt tile adhesives	50
Drywall and panel adhesives	50
Cove base adhesives	50
Multipurpose construction adhesives	70
Structural glazing adhesives	100
Single-ply roof membrane adhesives	280
Other adhesives	50

SPECIALTY APPLICATIONS	
PVC welding	CPVC welding
510	480
ABS welding	325
Plastic cement welding	250
Adhesive primer for plastic	550
Contact adhesive	80
Special purpose contact adhesive	250
Structural wood member adhesive	140
Top and trim adhesive	250

SUBSTRATE SPECIFIC APPLICATIONS	
Metal to metal	Plastic foams
30	50
Porous material (except wood)	50
Wood	30
Fiberglass	80

1. If an adhesive is used to bond dissimilar substrates together, the adhesive with the highest VOC content shall be allowed.
2. For additional information regarding methods to measure the VOC content specified in this table, see South Coast Air Quality Management District Rule 1168

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS. IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.


THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONNING: R-4
CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP

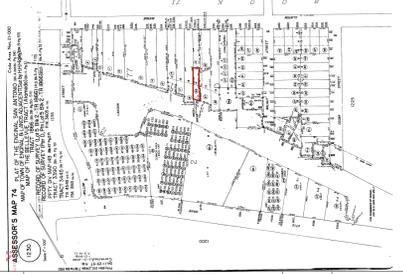

REV:	DESCRIPTION:	BY:	DATE:
△			
△			
△			
△			

STATUS: DESIGN STAGE

DESIGNER:

(213) 618-5456
ANDREW ATAMANIUK
permits@atamanstudio.com



ATAMAN STUDIO

CLIENT:
Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com

SITE:
2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501

TITLE:
(E) TWO-STORY TYPE V-B, NON-SPRINKLERED SFD TO BE REMODELED 1,532 SF + (P) ADDITION TO THE FIRST FLOOR 202.4 SF + (P) ADDITION TO THE BASEMENT FLOOR 202.4 SF
TOTAL 1,936.8 SF

DRAWING TITLE:

GREEN BUILDING NOTES

SCALE AT ARCH D: DATE: 12/24/2025

PROJECT NO: DRAWING NO:

A18.1

GENERAL CONTRACTORS / OWNER SHALL VERIFY SITE, DIMENSIONS, ELEVATIONS, GRADE, SOIL RESTRICTIONS AND ALL FIELD CONDITIONS RELATED TO DESIGN / DRAWINGS OR LOCAL CODES AND REGULATIONS, IF ANY DISCREPANCIES ARE FOUND, CONTRACTOR / OWNER SHALL IMMEDIATELY NOTIFY THE PARTIES, ARCHITECT, ENGINEER, ETC. SURVEYOR SHALL VERIFY LOT / BUILDING CORNERS, DRAINS.

THESE DRAWINGS SHALL NOT BE CONSIDERED COMPLETE AND READY FOR CONSTRUCTION UNTIL A BUILDING PERMIT HAS BEEN ISSUED.

LEGAL DESCRIPTION:

LOT #: 20
APN #: 074-1230-020-00
ZONNING: R-4
CONSTRUCTION TYPE: TYPE V-B

BLANK SPACE FOR APPROVAL STAMP

ASSESSOR'S MAP



REV:	DESCRIPTION:	BY:	DATE:
1			
2			
3			

STATUS: DESIGN STAGE

DESIGNER:

(213) 618-5456
ANDREW ATAMANIUK
permits@atamanstudio.com

ATAMAN STUDIO

CLIENT:
Meghan Noonan
(301) 305-0866
Meghannoonan@yahoo.com

SITE:
2146 1/2 CLINTON AVE,
ALAMEDA, CA 94501

TITLE:
(E) TWO-STORY TYPE V-B, NON-
SPRINKLERED SFD TO BE REMODELED
1,532 SF + (P) ADDITION TO THE FIRST
FLOOR 202.4 SF
+ (P) ADDITION TO THE BASEMENT FLOOR
202.4 SF
TOTAL 1,936.8 SF

DRAWING TITLE:

SCALE AT ARCH D: DATE: 12/24/2025

PROJECT NO: DRAWING NO:

Client Confirmation and Agreement Regarding the Project

I, **BRIAN WIMER**, as the Client (hereinafter referred to as the "Client"), confirm that:

1. Familiarization with the Design

I have thoroughly reviewed all the provided documentation and design solutions, including drawings, technical specifications, materials, and details related to this project. I confirm that the provided materials meet my expectations and requirements.

2. Approval of the Final Design

I confirm that all changes, adjustments, and suggestions made by me during the project development process have been considered and incorporated. The final design submitted for approval fully meets my requirements, and I consent to its implementation.

3. Changes to the Design After Approval

I understand and agree that after the approval of this document, any further changes to the design will not be possible without additional costs. Any changes that arise after this point can only be made after written agreement with the designer and will result in additional expenses for the Client. The cost of the changes will be determined separately and may vary depending on the scope of changes, materials, and other factors.

4. Authorization to Submit the Project

I grant the designer full permission to submit this project to the relevant authorities for review and to obtain permits or other necessary documents. I confirm that this project is ready for official submission.

5. No Verbal Agreements

I confirm that no verbal agreements have been made between me and the designer that are not documented in writing. All agreements and terms of collaboration are clearly outlined in written documents, and no additional obligations have been assumed without proper written documentation.

6. Review and Approval of Materials

All materials, technical specifications, and project requirements have been thoroughly reviewed and approved by me at the time of signing this document. I understand that any further adjustments may impact the final cost and timeline of the project.

7. Responsibility for Final Decision

I acknowledge that by signing this document, I am providing final approval for all aspects of the project. Responsibility for the decisions regarding the design, materials, and other project specifications rests fully with me as the Client.

Date:

Client Signature:

Client Name (in print):